




A New Isolation Building Facility

Washoe Park Trout Hatchery

FWP Project #7153604

WRN Architects

Architecture : Planning : Consulting



3112 South Third West Missoula
Missoula, Montana 59804
phone (406) 829-0788
e-mail ncrisonaia@bresnan.net
wrnarchitects.com

The work shown in these documents is
protected by copyright law. Any use or
reproduction without the written consent
of the Architect is a violation of law.

a new isolation facility for :
Washoe Park Trout Hatchery
Montana Fish Wildlife and Parks
Anaconda, Montana

Consultants

Structural :
Beaudette Consulting Engineers
113 West Main Street
Missoula, Mt 59802 (406) 721-7315

Mechanical :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Electrical :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Plumbing :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Geotechnical :
Robert Peccia and Associates
P.O. Box 5053, 825 Custer Avenue
Helena, MT 59604 (406) 447-5000

Date : 04 - 27 - 2016

Project Number : 015-007

Drawn By : Wm. R. N.

Checked By : Wm. R. N.

Revisions :

COVER SHEET
PROJECT INFO.
INDEX OF DRAWINGS

A - 1


of

5

ABBREVIATIONS

A.	Area	Elev.	Elevation	M.B.	Machine Bolt	Sec.	Section
A.B.	Anchor Bolt	E.J.	Expansion Joint	Mas.	Masonry	Sht.	Sheet
A.C.T.	Acoustical Ceiling Tile	Eq.	Equal	M.O.	Masonry Opening	S.V.	Sheet Vinyl
Add'l	Additional	Exist.	Existing	Matl.	Material	Sim.	Similar
A.F.F.	Above Finished Floor	Ext.	Exterior	Max.	Maximum	S.D.	Smoke Detector
Alt.	Alternate	E.F.	Exhaust Fan	Mech.	Mechanical	S.C.	Solid Core
Alum./Al.	Aluminum			Md.	Metal	Spec.	Specification
				M.E.	Metal Edge	Sq.	Square
				Min.	Minimum	S.F.	Square Foot/Fect
B.B.	Base Board	F.O.S.	Face Of Stud	Misc.	Miscellaneous	S.S.	Stainless Steel
Bld'g	Building	F.R.P.	Fiberglass Reinforced Panel	M.R.	Moisture Resistant	Std.	Standard
Blk'g	Blocking	Fin.	Finish	Md.	Mounted	Stl.	Steel
Bm.	Beam	F.F.	Finished Floor	No./#	Number	St.	Stain
Bot.	Bottom	F.E.	Fire Extinguisher	N.T.S.	Not To Scale	Susp.	Suspended
Btwn	Between	F.E.C.	Fire Exting. Cabinet	(N)	New	Sym.	Symmetrical
		Flr.	Floor	N.L.C.	Not in Contract		
Cab.	Cabinet	F.D.	Floor Drain			T.	Tread
CI	Cast Iron	F.T.	Foot/Fect			T.B.	Towel Bar
Clg.	Ceiling	Fig.	Footing			T.&G.	Tongue & Groove
C.H.	Ceiling Height	Fdn.	Foundation	O.A.L.	Over All Length	Thk.	Thick
C.J.	Construction Joint	F.P.H.B.	Frost Proof Hose Bib	O.C.	On Center	Thknd.	Thickened
C.B.	Corner Bead	Furn.	Furnace	O.D.	Outside Diameter	T.S.	Tube Steel
C.G.	Corner Guard	F&I	Furnish(ed) & Install	Opng.	Opening	Typ.	Typical
C.L.	Center Line			Oper.	Operable	T.O.	Top of
Clr.	Clear			Opp.	Opposite		
C.M.U.	Concrete Masonry Unit			O.W.S.J	Open Web Steel Joist	U.B.C.	Uniform Building Code
Col.	Column	Galv.	Galvanized			U.L.	Underwriter's Laboratory Inc.
Conc.	Concrete	Ga.	Gauge	P	Paint	U.C.	Undercut
Config.	Configuration	G.D.	Garbage Disposal	Pl.	Painted	U.N.O.	Unless Otherwise Noted
Conn.	Connection	Gl.	Glass/Glazing	Part.	Partition	Ur.	Urinal
Constr.	Construction	G.L.B.	Glue Laminated Beam	P.H.	Paper Holder		
Cont.	Continuous	Gr.	Grade	PL	Plate	Vert.	Vertical
C.O.	Convenience Outlet or Clean Out	G.F.I.	Ground Fault Insulated	PL	Plate/Property Line	Var.	Varnish
		G.W.B.	Gypsum Wall Board	Pc.	Plastic Laminite	V.C.T.	Vinyl Composition Tile
Cpt.	Carpet	Gyp.	Gypsum	P-lam	Plumbing	V.C.B.	Vinyl Cove Base
				Plywd.	Plywood	V.I.F.	Verify in Field
				P.T.	Porcelain Tile	Vert.	Vinyl Wall Covering
Dbl.	Double	H.R.	Handrail	P.S.I.	Pounds per Square Inch		
Dd.	Detail	Hdw.	Hardware	P.S.F.	Pounds per Square Foot	W.	Washer
Dia.	Diameter	Hdr.	Header	P.C.	Pre Cast	Wd.	Wood
Dim.	Dimension	H.V.A.C.	Heating Ventilation and Air Conditioning	PL	Property Line	Win.	Window
D.W.	Dish Washer			P.C.	Pull Chain	W.P.	Water Proof
Div.	Division	Ht.	Height	Quant.	Quantity	W.W.F.	Welded Wire Fabric
Dr.	Down	H.C.	Hollow Core	Q.T.	Quarry Tile	w/	With
Dn.	Down	H.M.	Hollow Metal	Rad.	Radius		
D.F.	Down	Horiz.	Horizontal				
D.	Drinking Fountain	H.W.	Hot Water				
Dwg.	Drawing						
		I.B.C.	International Building Code	Ref.	Reference		
Ea.	Each	I.D.	Inside Diameter	Refer.	Refrigerator		
E.I.F.S.	Exterior Insulation Finish System	Insul.	Insulation	Rein.	Reinforcing		
Elec.	Electric/Electrical	Int.	Interior	Req'd.	Required		
		Int.	Joint	Rev.	Revision		
		Jst.	Joist	R.	Riser		
				R.&S.	Rod & Shelf		
		Lav.	Lavatory	R.D.	Roof Drain		
		Ldr.	Leader	Rm.	Room		
		Lgt	Light	R.O.	Rough Opening		
				R.F.	Rubber Flooring		
				Ref.	Reference		
				Req'd	Required		
				R.H.	Robe Hook		
				R.I.	Rigid Insulation		
				Rm.	Room		

SYMBOLS

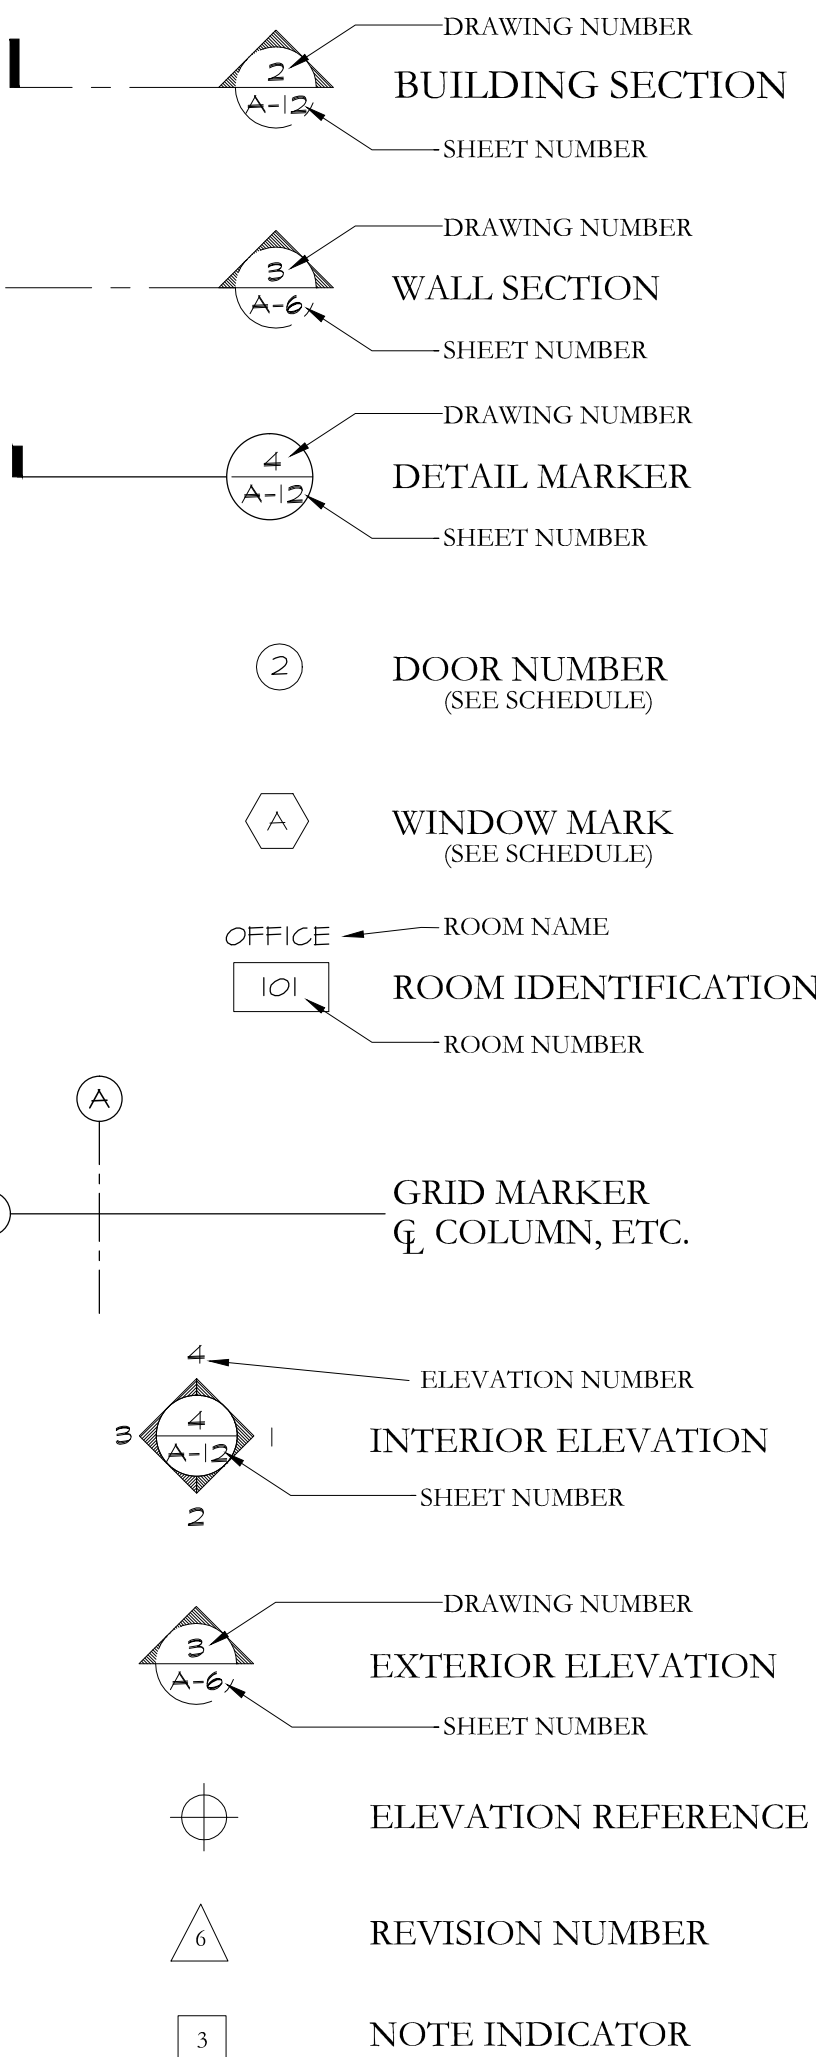


INDEX OF DRAWINGS

- A-1 : COVER SHEET / CODE AND PROJECT INFORMATION
- A-2 : SITE PLAN
- A-3 : FOUNDATION, FLOOR AND ROOF FRAMING PLANS
- A-4 : EXTERIOR ELEVATIONS / TYPICAL WALL SECTION
- A-5 : BUILDING SECTIONS / DETAILS
- ME : COVER SHEET AND GENERAL NOTES
- M-1 : HVAC PLAN
- M-2 : PLUMBING PLAN
- M-3 : EQUIPMENT SCHEDULES AND DETAILS
- E-1 : LIGHTING AND POWER FLOOR PLAN
- E-2 : ELECTRICAL SCHEDULES

PROJECT DATA

BUILDING USE: _____ Pisciculture
ZONING: _____ Open Space Development
OCCUPANCY: _____ B
TYPE OF CONSTRUCTION: _____ Type VB
BLDG. HEIGHT: _____ 15'-2 1/2" above finished grade
No. OF STORIES: _____ 1-story above crawl space
ACTUAL AREA / FLOOR: _____ 400 s.f. total
ALLOWABLE AREA / FLOOR: _____ 8,000 s.f.
ALLOWABLE AREA INCREASE: _____ N/A
SEISMIC ZONE: _____
WIND: _____
EXPOSURE: _____
FLOOR LOAD- DEAD LOAD: _____
LIVE LOAD: _____
ROOF LOAD - DEAD LOAD: _____
LIVE LOAD: _____
SOIL BEARING CAPACITY: _____

SEE SOILS REPORT AND STRUCTURAL
GENERAL NOTES FOR SPECIFIC INFORMATION



3112 South Third West Missoula
Missoula, Montana 59804
phone (406) 829-0788
e-mail ncrisonaia@brennan.net
wrnarchitects.com

The work shown in these documents is
protected by copyright law. Any use or
reproduction without the written consent
of the Architect is a violation of law.

a new isolation facility for :
Washoe Park Trout Hatchery
Montana Fish Wildlife and Parks
Anaconda, Montana

Consultants

Structural :
Beaudette Consulting Engineers
113 West Main Street
Missoula, Mt 59802 (406) 721-7315

Mechanical :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Electrical :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Plumbing :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000


Geotechnical :
Robert Peccia and Associates
P.O. Box 5633, 825 Guster Avenue
Helena, MT 59604 (406) 447-5000

Date : 04 - 27 - 2016
Project Number : 015-007
Drawn By : Wm. R. N.
Checked By : Wm. R. N.
Revisions :


+

SITE PLAN


A - 2
of
5

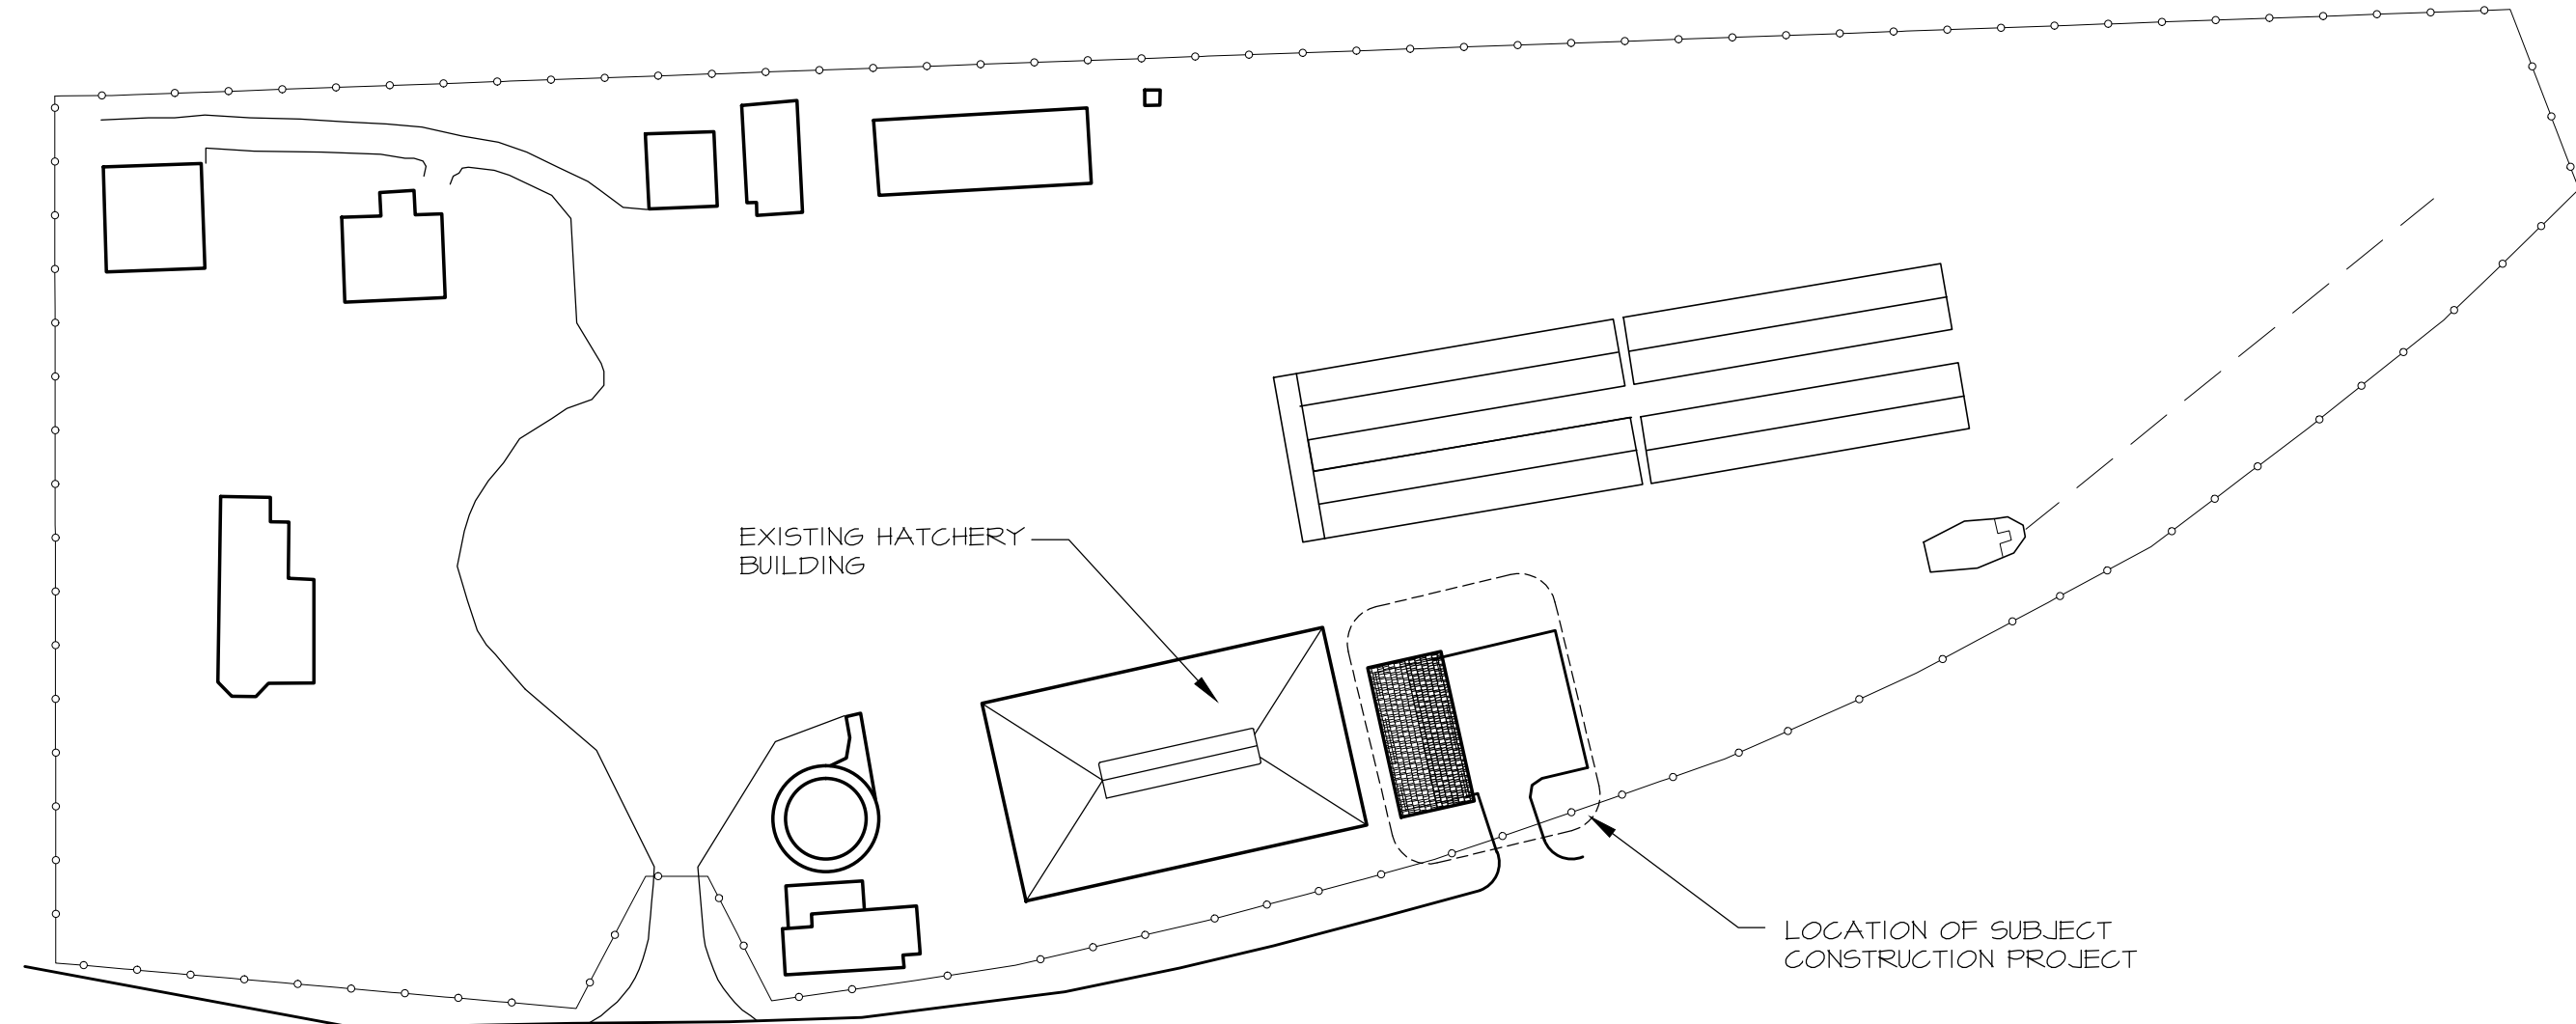


1 HATCHERY SITE PLAN
A-2 NOT TO SCALE

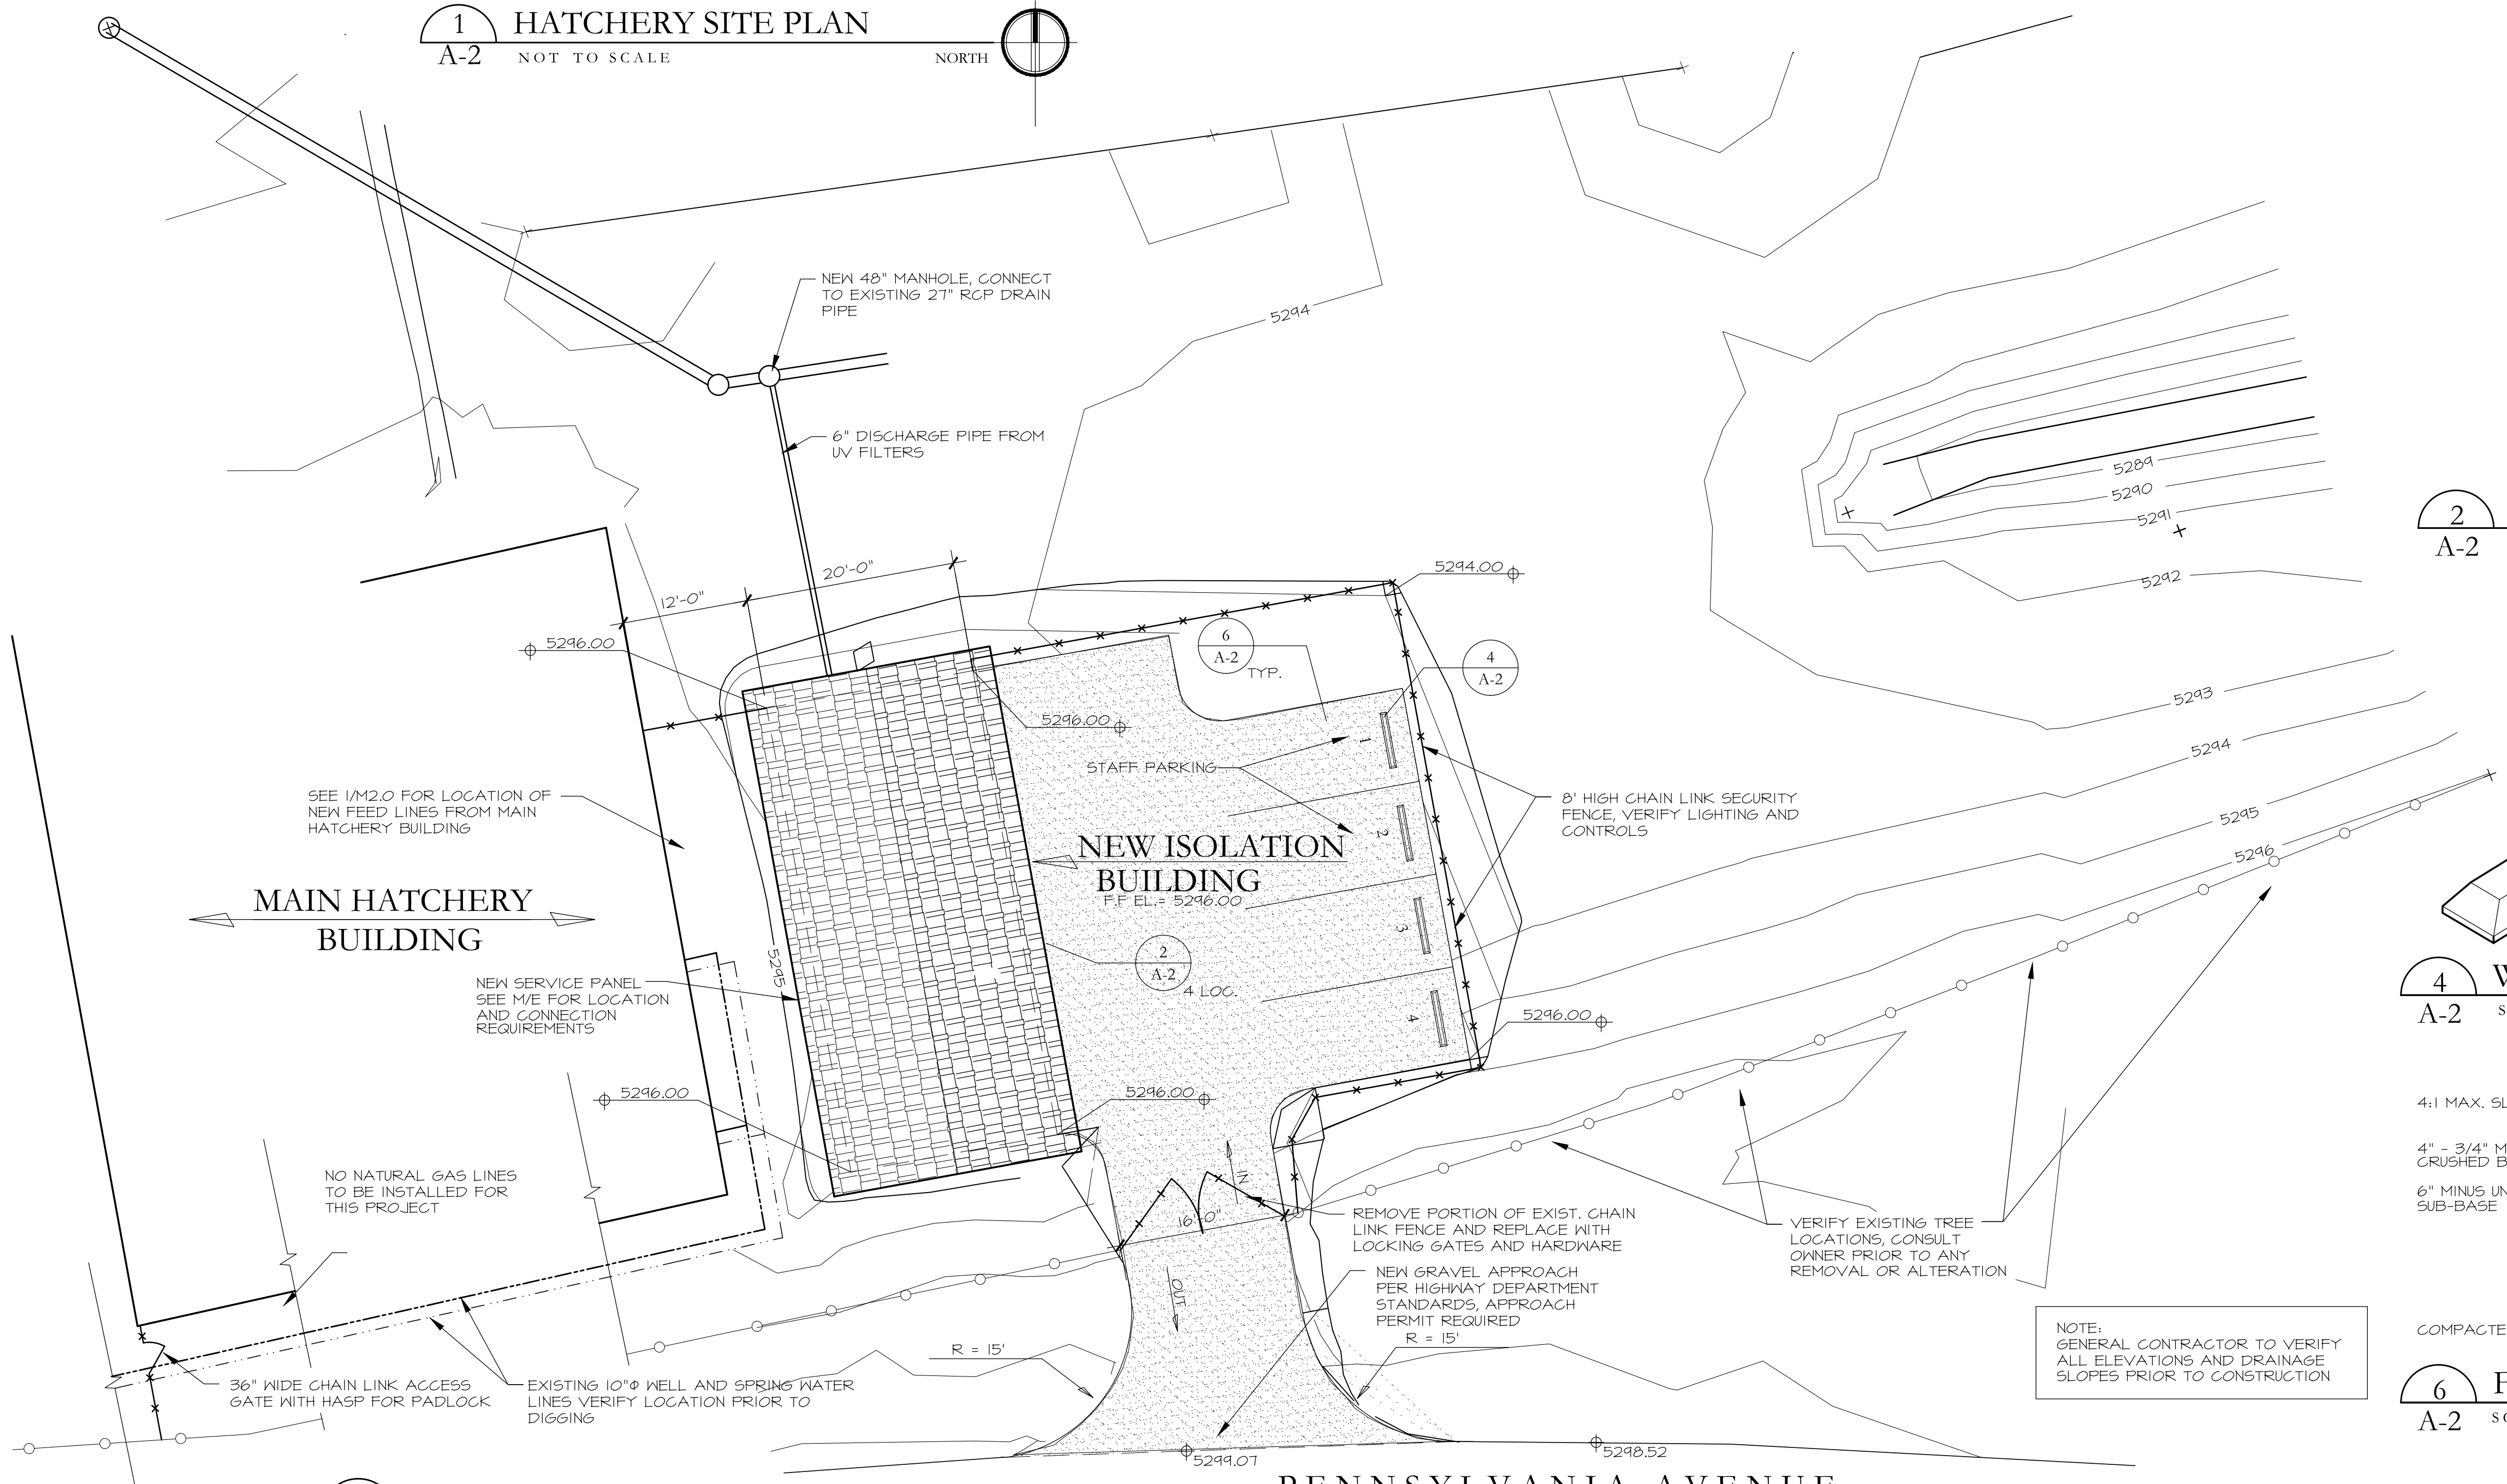


3 PROJECT SITE PLAN
A-2 SCALE: 1" = 10'-0"

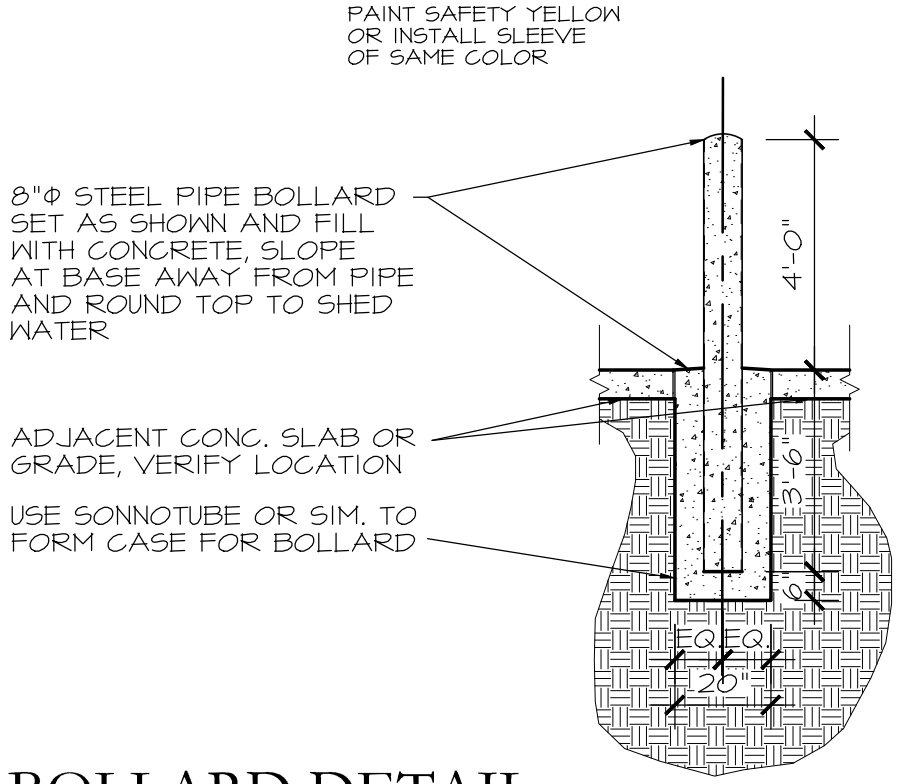


2 BOLLARD DETAIL
A-2 SCALE: 1" = N.T.S.

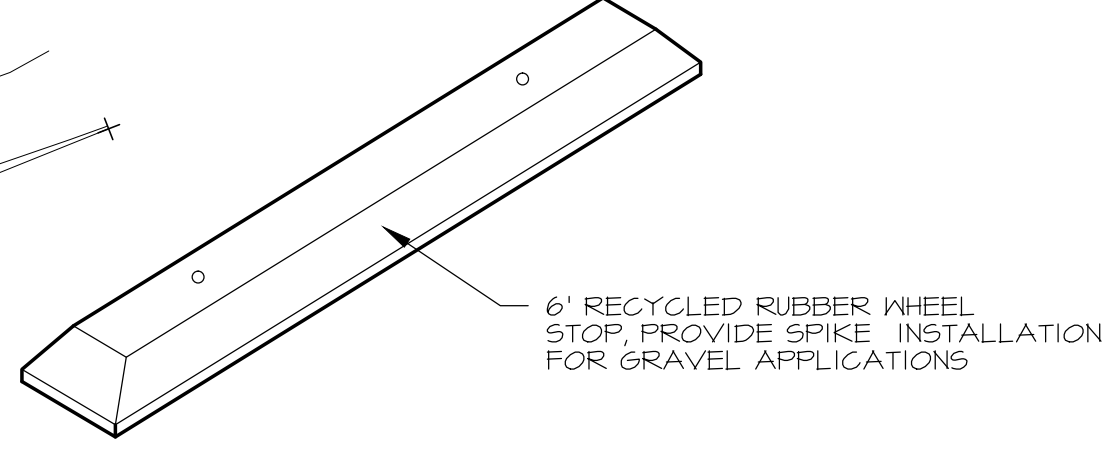

4 WHEEL STOP
A-2 SCALE: 1" = N.T.S.

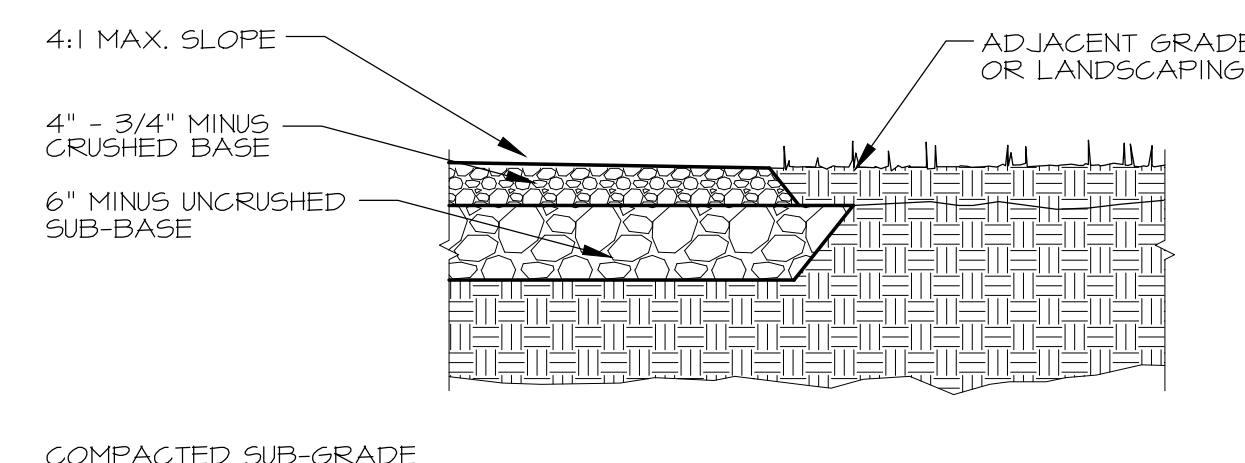

6 FINISH GRADING
A-2 SCALE: 1" = N.T.S.

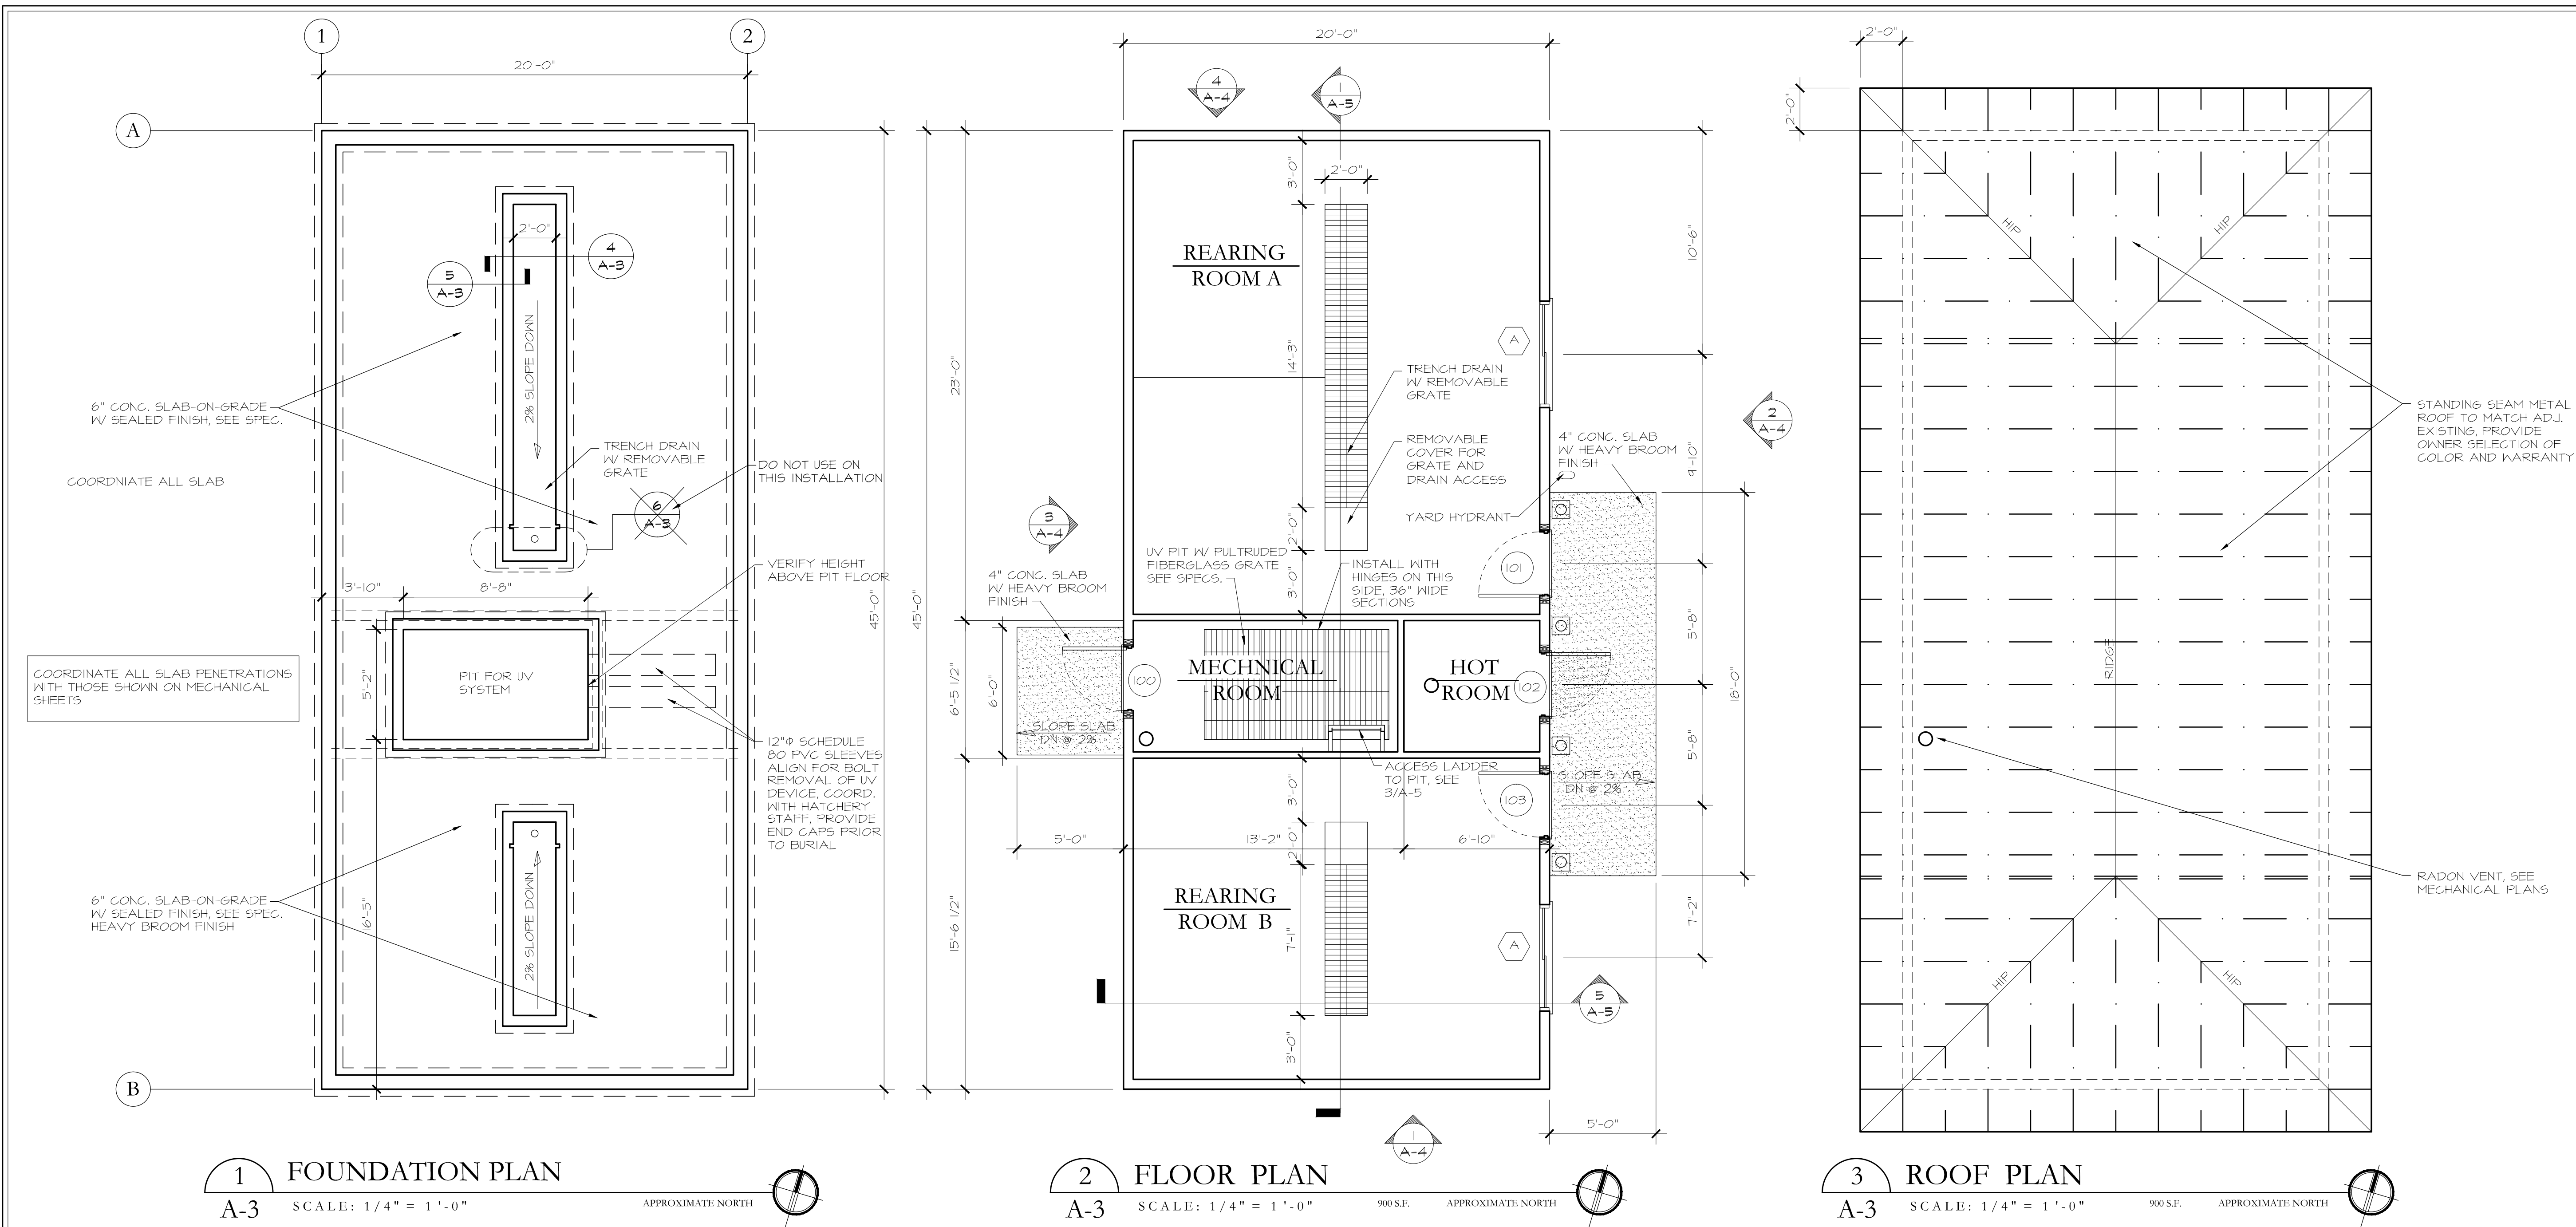

DOOR SCHEDULE												
DOOR							HDWARE	GLASS	DETAILS			
DOOR NO.	SIZE	LABEL	TYPE	THICK	MATL.	FINISH	GROUP	TYPE	HEAD			FRAME
									HEAD	JAMB	SILL	
100	3'-0" x 6'-8"	-	A	1 3/4"	HM	PTD.		LOW-E	-	-	-	-
101	3'-0" x 6'-8"	-	A	1 3/4"	HM	FAC.		LOW-E	-	-	-	-
102	3'-0" x 6'-8"	-	A	1 3/4"	HM	FAC.		LOW-E	-	-	-	-
103	3'-0" x 6'-8"	-	A	1 3/4"	HM	PTD.		LOW-E	-	-	-	-
HEAD, SILL AND JAMB DETAILS PER MFR. SPECIFICATIONS TO BE SUBMITTED TO ARCHITECT PRIOR TO ORDERING												
WINDOW SCHEDULE												
MARK	TYPE	SIZE	MATL.		FIN.	FRAME	GLASS	HEAD	SILL	JAMB	REMARKS	QTY
A	SLIDER	5'-0" x 3'-6"	VINYL/FIBRGLSS		-	VINYL/FBRGLS	LOW-E	-	-	-	PROVIDE NON-METALIC SCREENS	2
TOTAL												2
DOOR TYPES				FRAME TYPES				WINDOW TYPES				
				ALL FRAMES TO HAVE THERMAL BREAK 								

WRN Architects

Architecture : Planning : Consulting

EST. BY BOBBY WASHOE & BOBBY WASHOE

BOBBY WASHOE

BOBBY WASHOE

BOBBY WASHOE

3112 South Third West, Missoula, Montana 59804
phone (406) 829-0788
e-mail wrn@wrnarchitects.com
The work shown in these documents is protected by copyright law. Any use or reproduction without the written consent of the Architect is a violation of law.

a new isolation facility for :

Washoe Park Trout Hatchery

Montana Fish Wildlife and Parks

Anaconda, Montana

Consultants

Structural : Beaudette Consulting Engineers
113 West Main Street
Missoula, MT 59802 (406) 721-7315

Mechanical : Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Electrical : Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Plumbing : Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Geotechnical : Robert Peccia and Associates
P.O. Box 5633, 825 Custer Avenue
Helena, MT 59604 (406) 447-5000

Date : 04 - 27 - 2016

Project Number : 015-007

Drawn By : Wm. R. N.

Checked By : Wm. R. N.

Revisions :

FOUNDATION PLAN


FLOOR PLAN / DOOR AND WINDOW SCHEDULES

TRENCH DETAILS

A - 3

of

5



3112 South Third West, Missoula, Montana 59804
phone (406) 829-0788
e-mail nelsonsmaia@brennan.net
wrnarchitects.com

The work shown in these documents is protected by copyright law. Any use or reproduction without the written consent of the Architect is a violation of law.

a new isolation facility for :
Washoe Park Trout Hatchery
Montana Fish Wildlife and Parks
Anaconda, Montana

Consultants

Structural :
Beaudette Consulting Engineers
113 West Main Street
Missoula, MT 59802 (406) 721-7315

Mechanical :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Electrical :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Plumbing :
Dawes Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Geotechnical :
Robert Peccia and Associates
P.O. Box 5633, 825 Custer Avenue
Helena, MT 59604 (406) 447-5000

Date : 04 - 27 - 2016

Project Number : 015-007





Drawn By : Wm. R. N.


Checked By : Wm. R. N.

Revisions :

EXTERIOR ELEVATIONS
TYPICAL WALL SECTION

A - 4
of
5

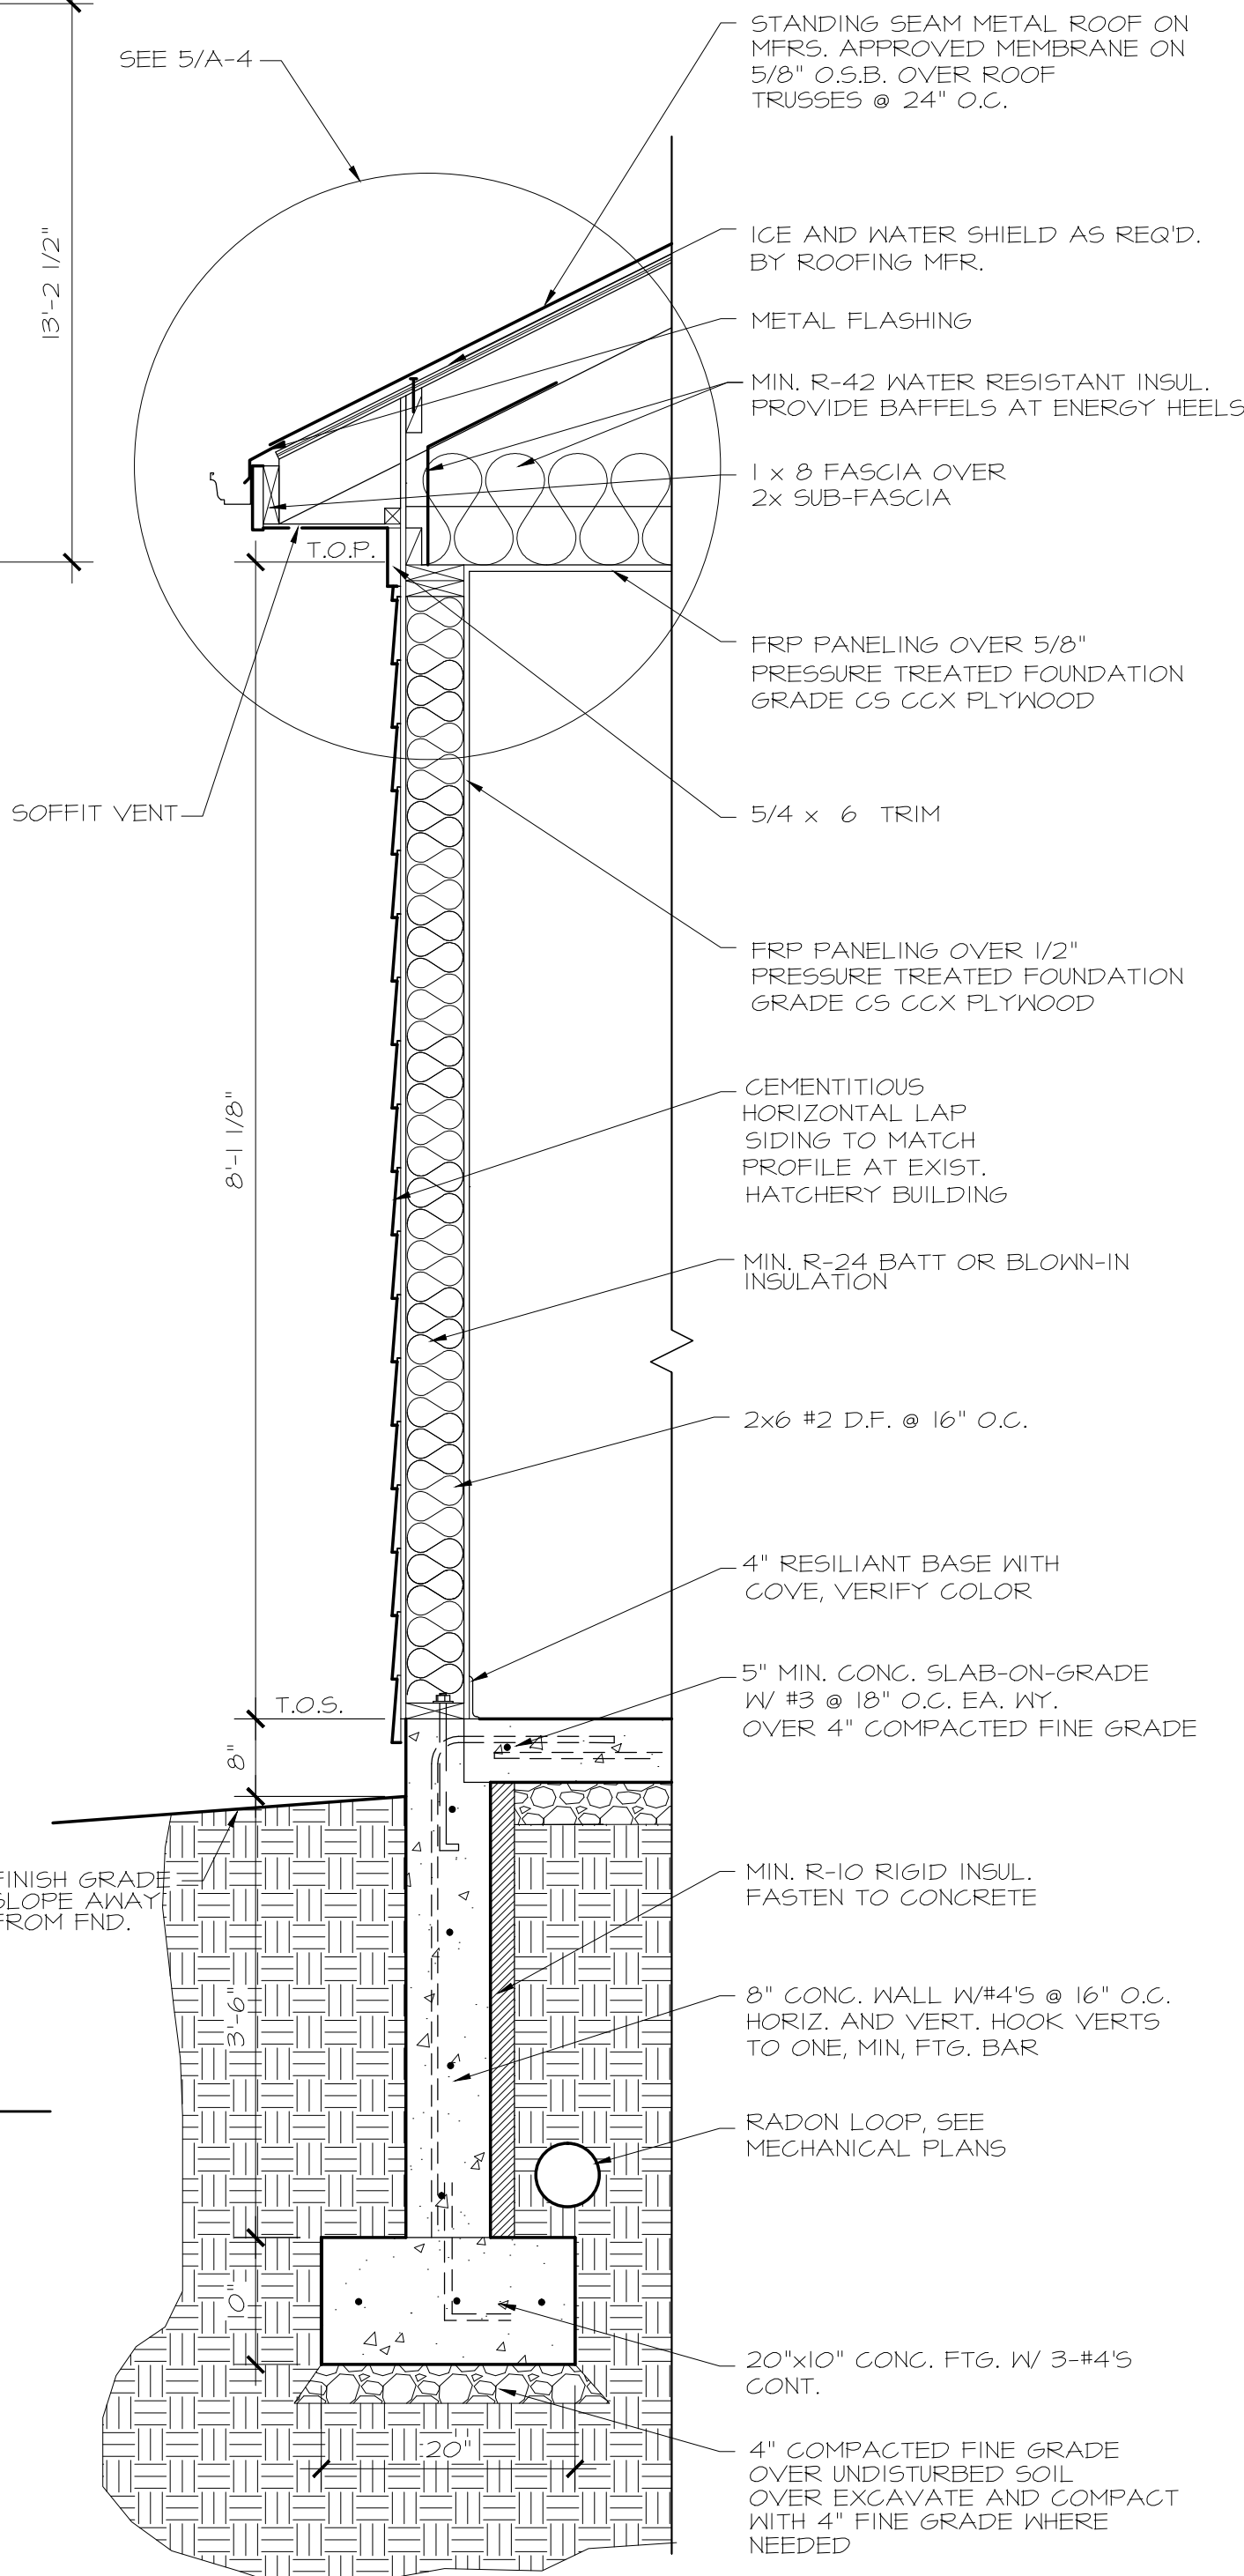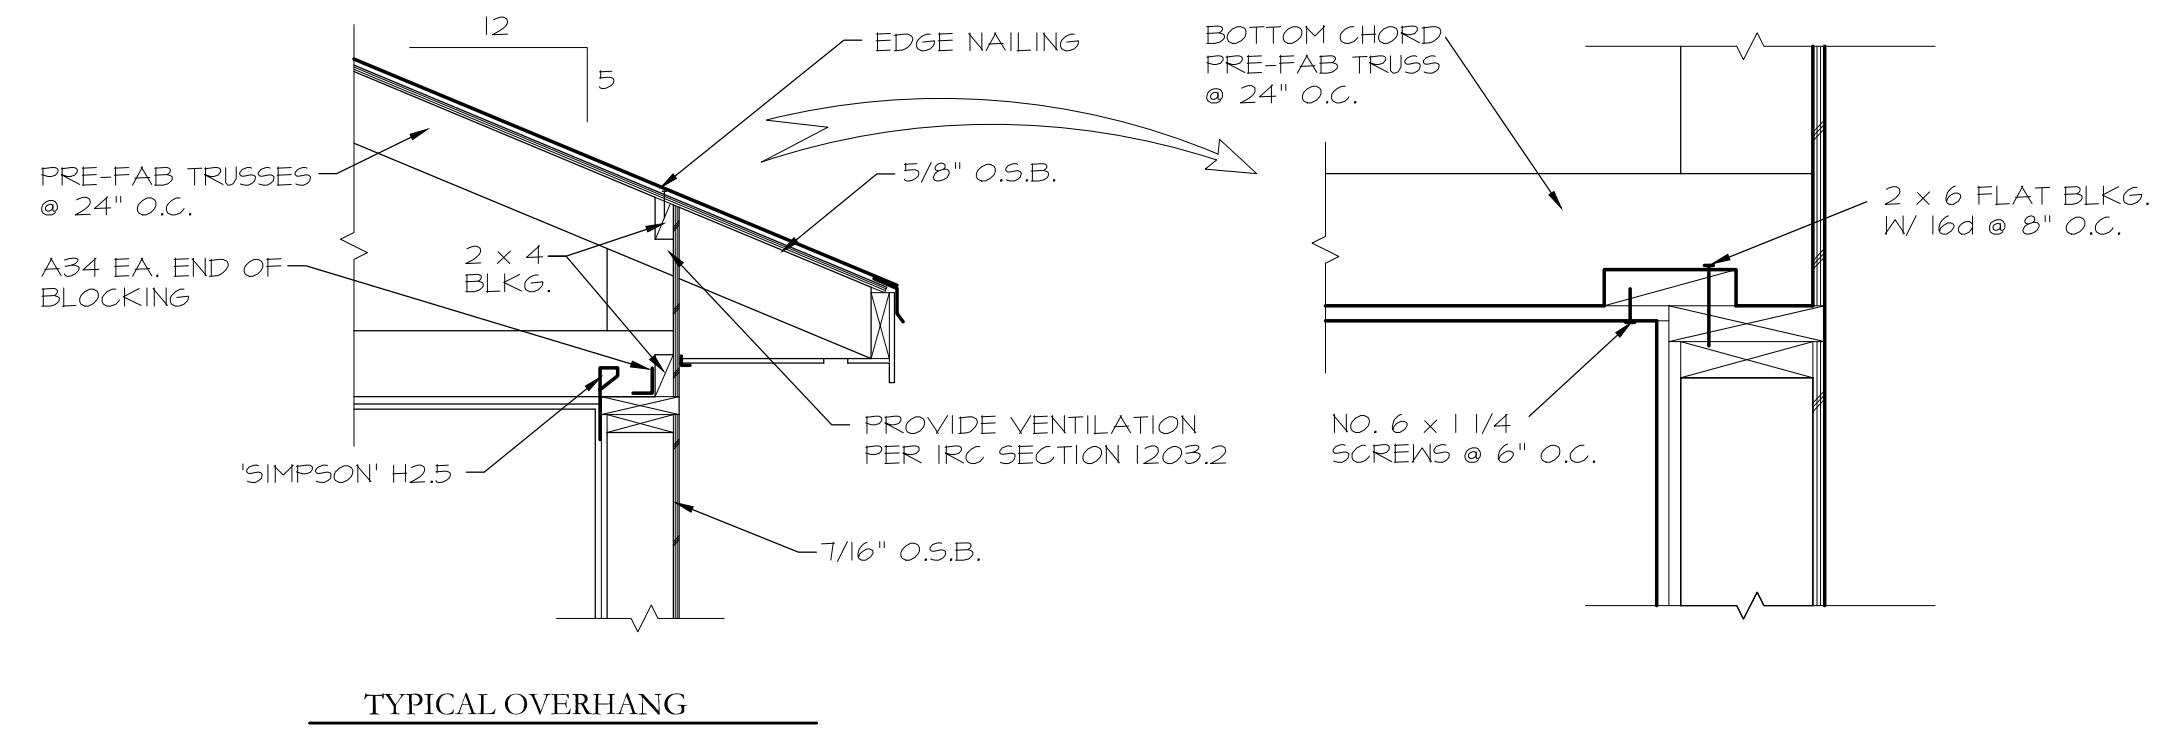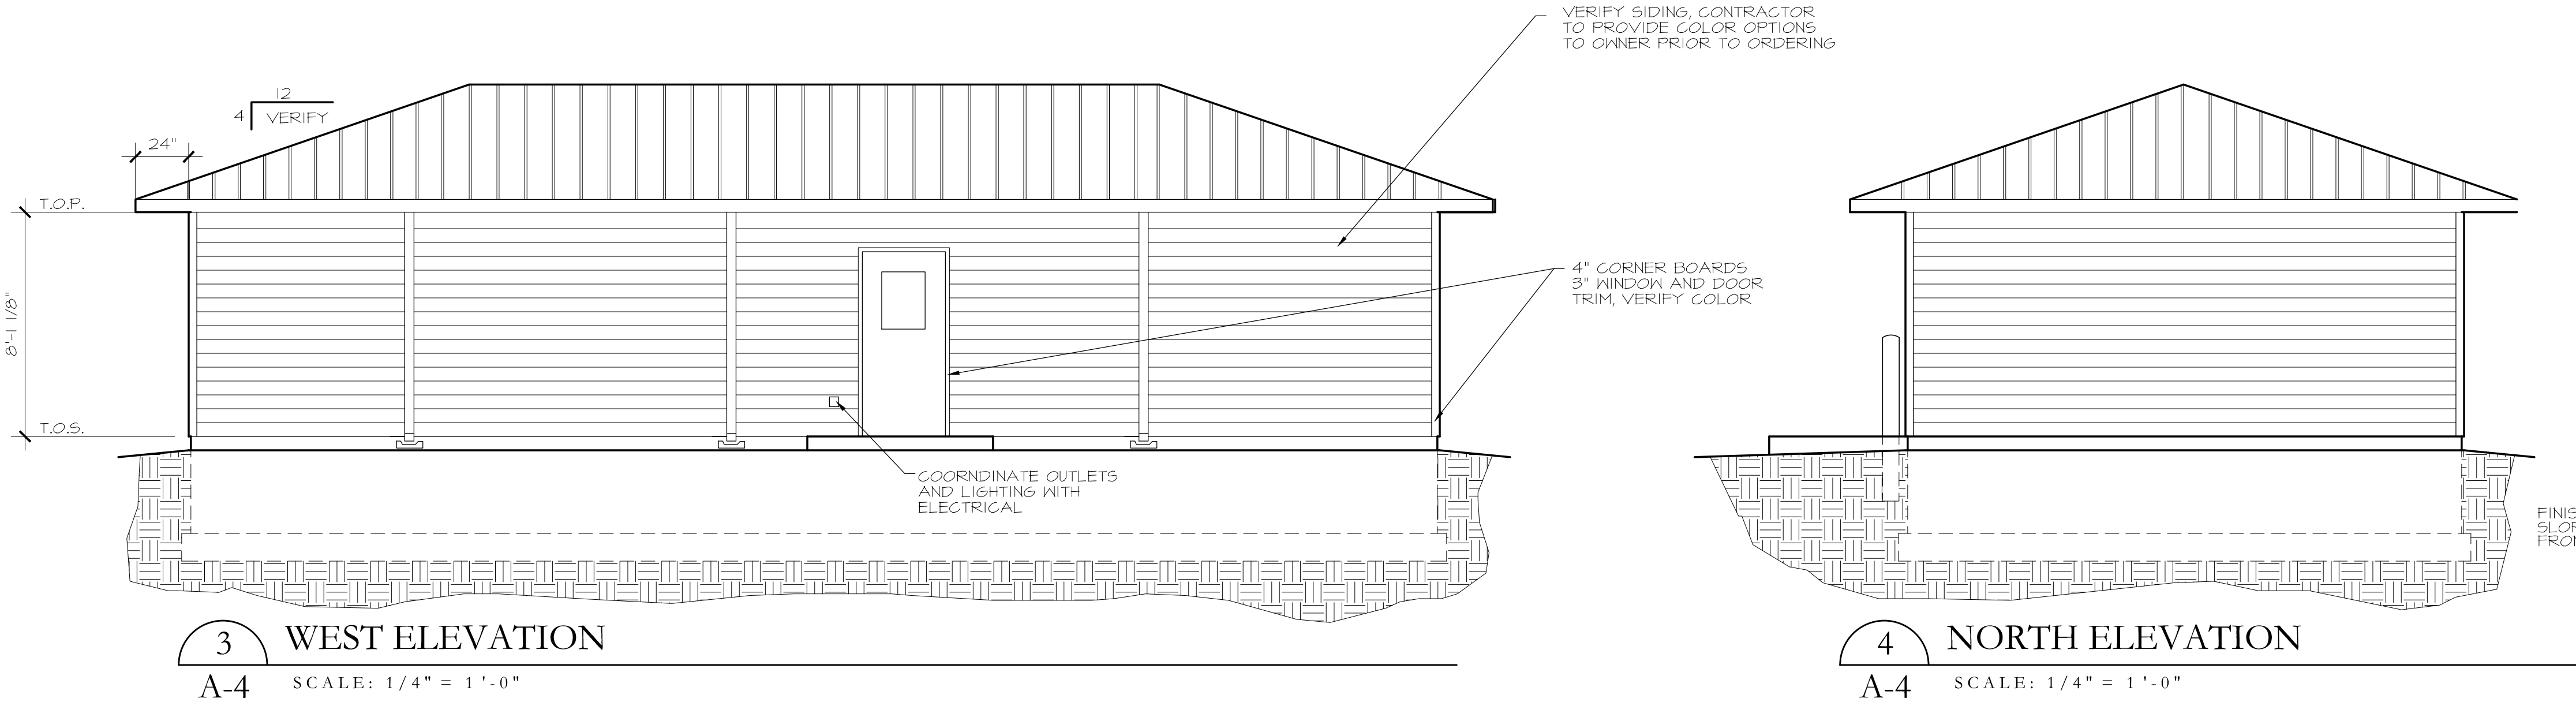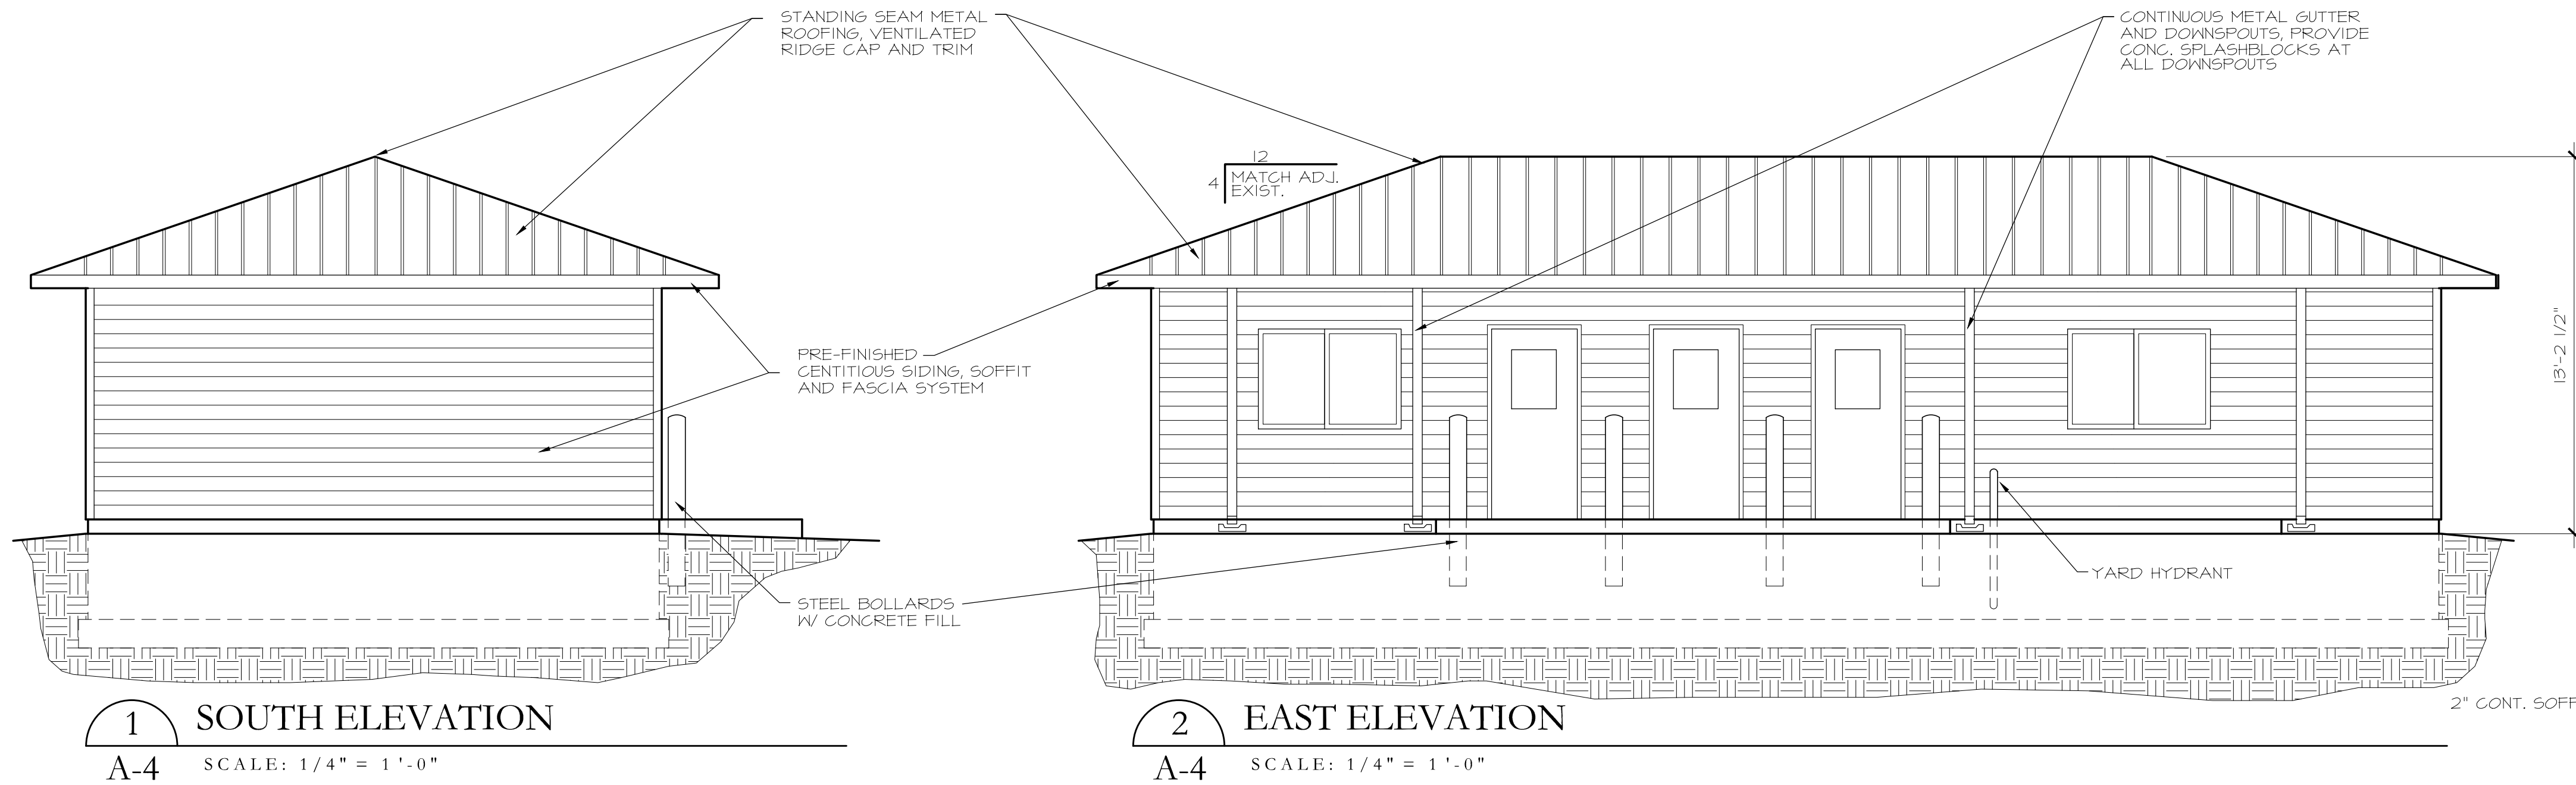



3112 South Third West Missoula, Montana 59804
phone (406) 829-0788
e-mail nersisomaia@brennan.net
wrnarchitects.com

The work shown in these documents is protected by copyright law. Any use or reproduction without the written consent of the Architect is a violation of law.

a new isolation facility for :
Washoe Park Trout Hatchery
Montana Fish Wildlife and Parks
Anaconda, Montana

Consultants

Structural :
Beaudette Consulting Engineers
113 West Main Street
Missoula, Mt 59802 (406) 721-7315

Mechanical :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Electrical :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Plumbing :
Daves Engineering & Design Co.
48 Hibbard Way
Helena, MT 59601 (406) 441-4000

Geotechnical :
Robert Peccia and Associates
P.O. Box 5653, 825 Gustaf Avenue
Helena, MT 59604 (406) 447-5000

Date : 04 - 27 - 2016

Project Number : 015-007


Drawn By : Wm. R. N.

Checked By : Wm. R. N.

Revisions :


BUILDING SECTIONS

A - 5
of
5

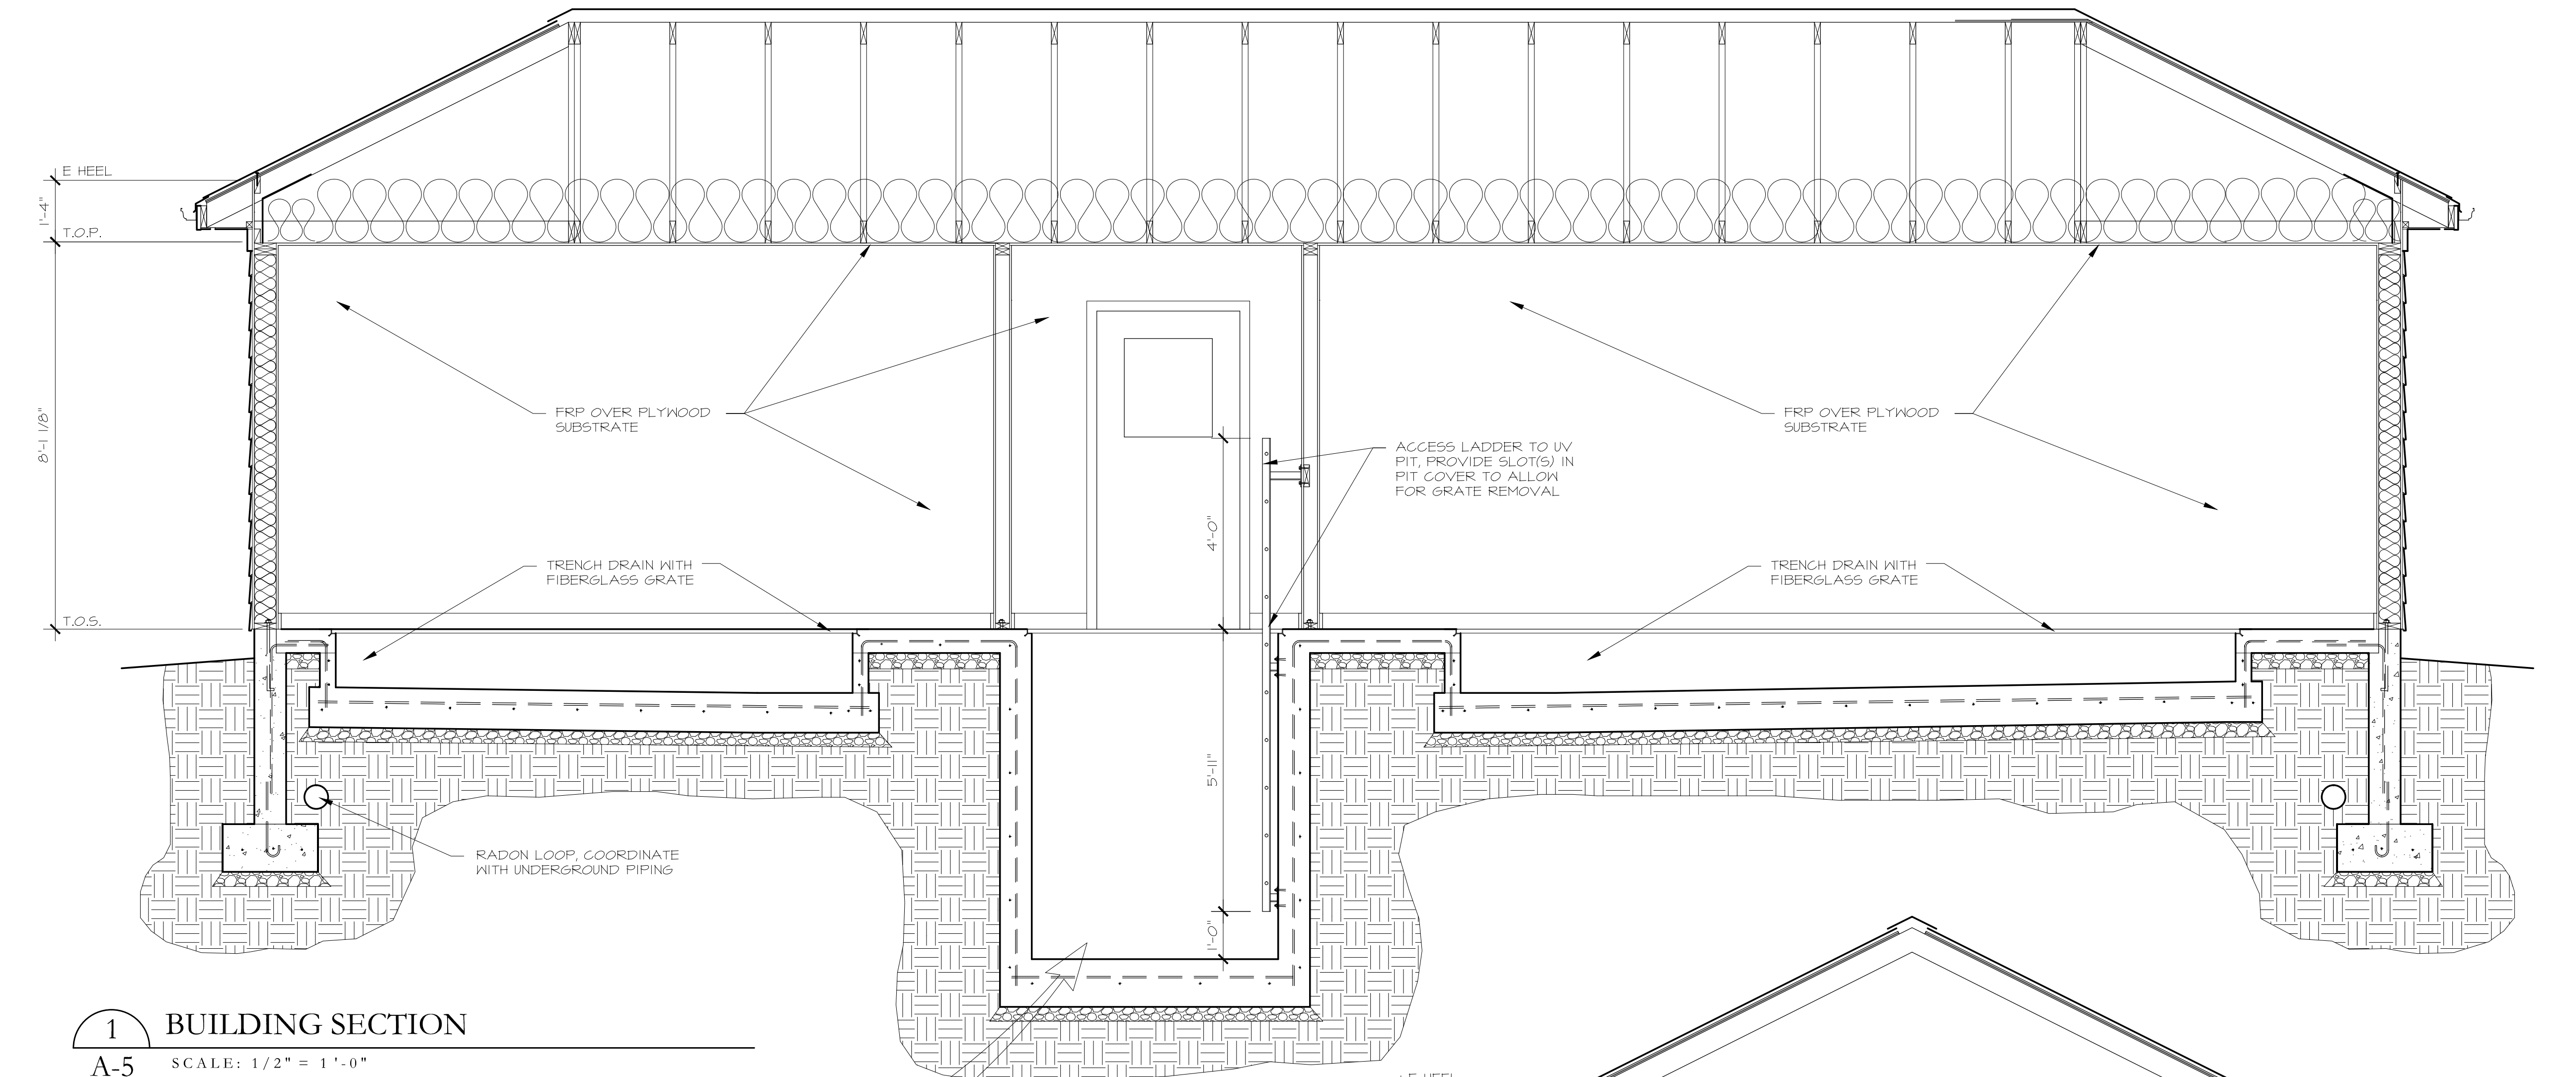


1 BUILDING SECTION

A-5 SCALE: 1/2" = 1'-0"

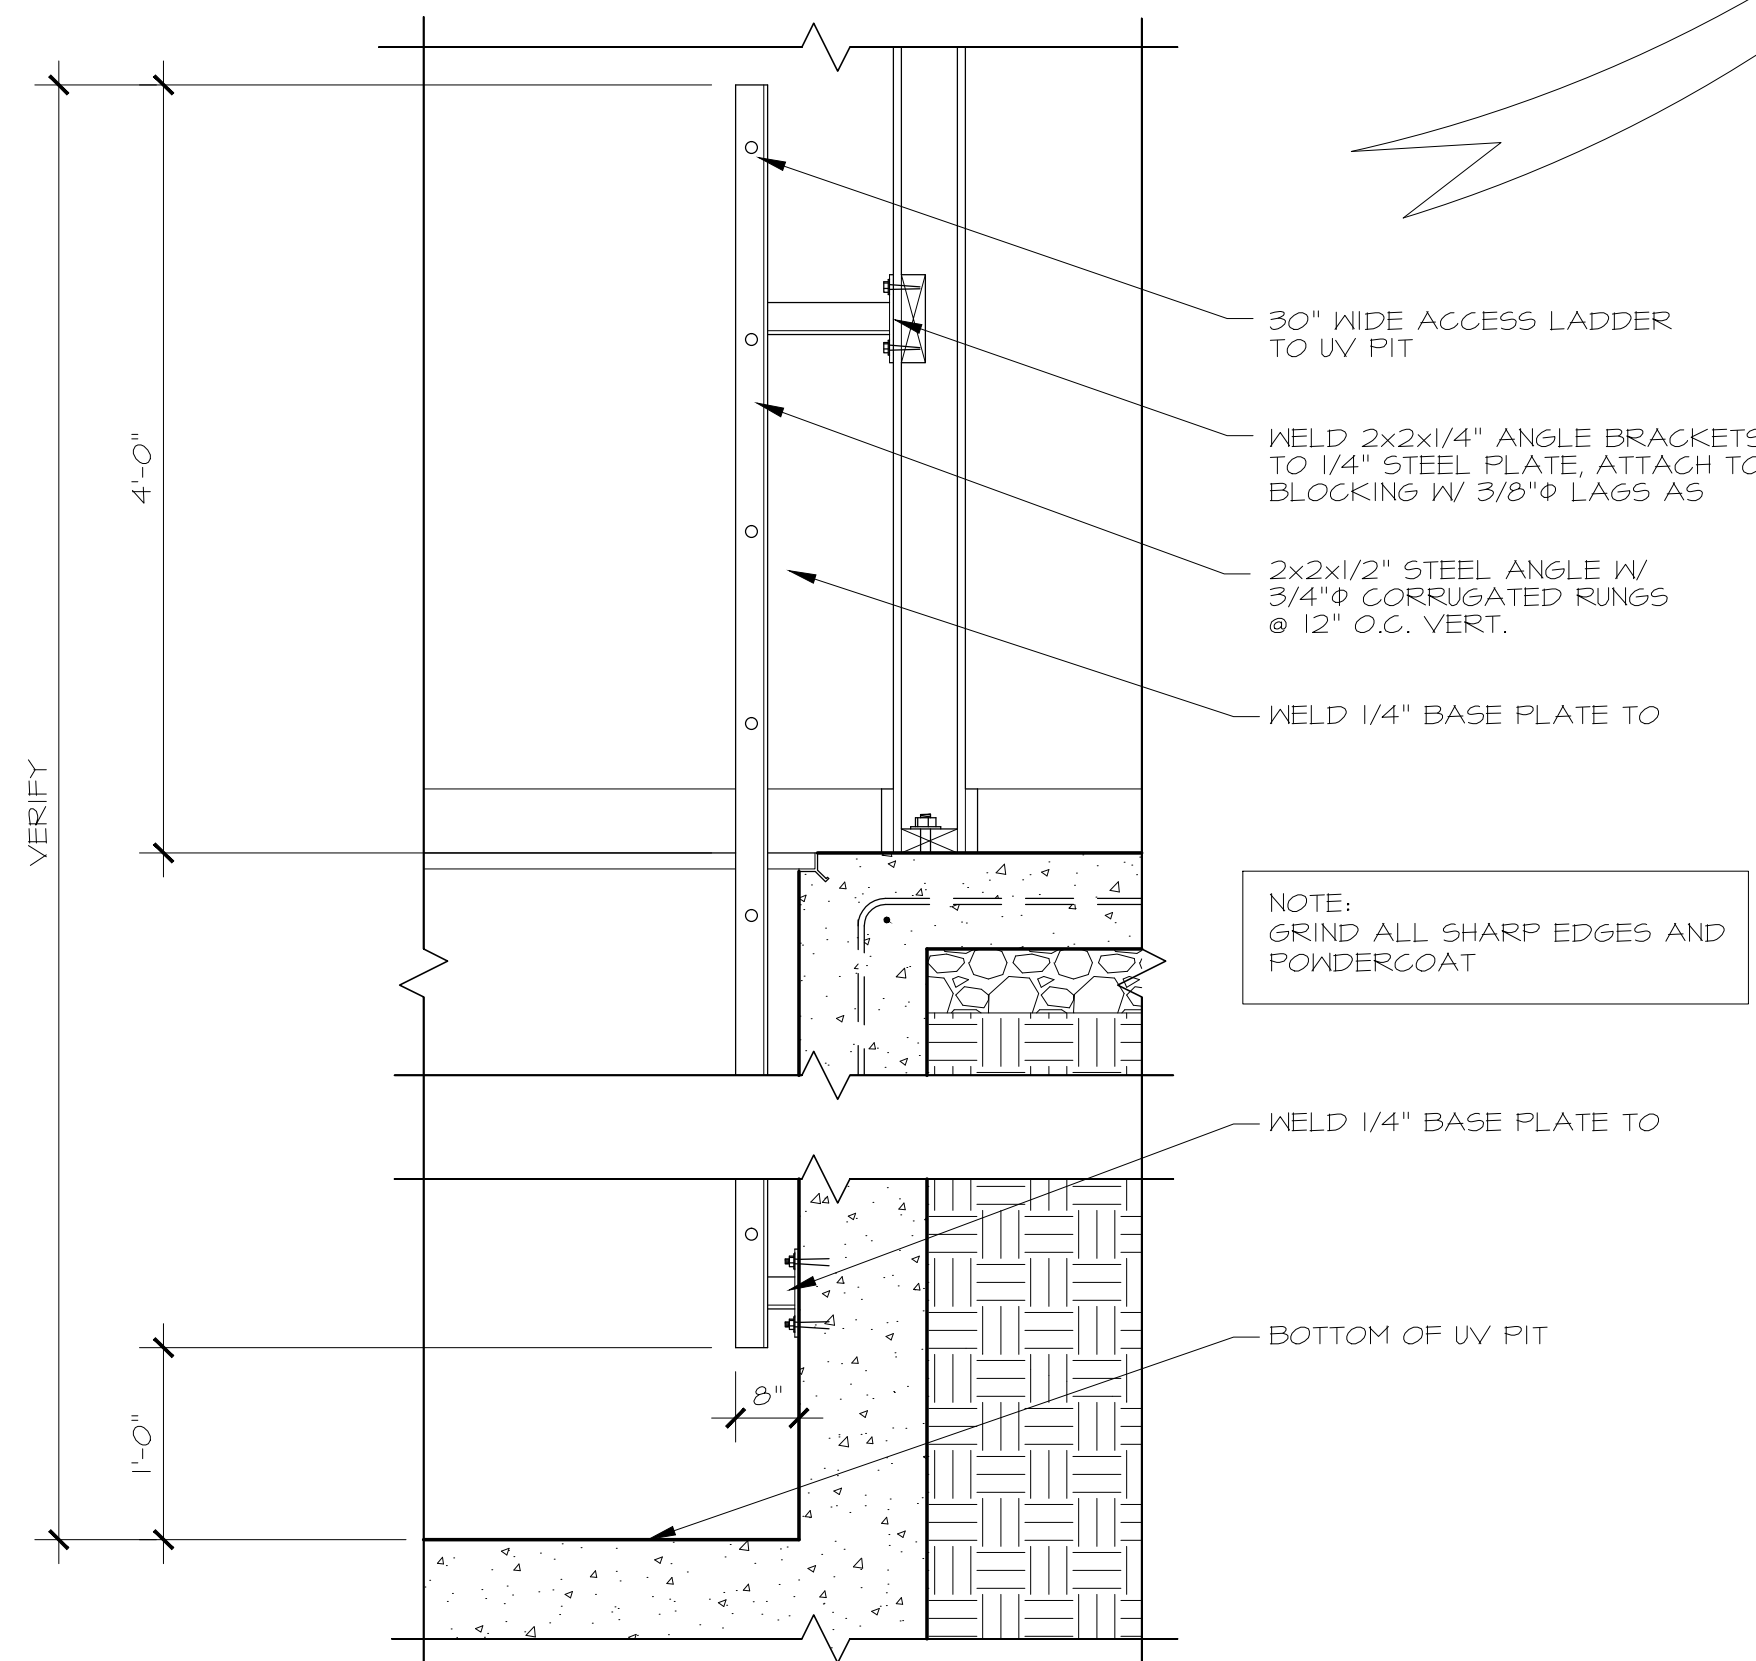

3 UV PIT LADDER

A-5 SCALE: 1/2" = 1'-0"

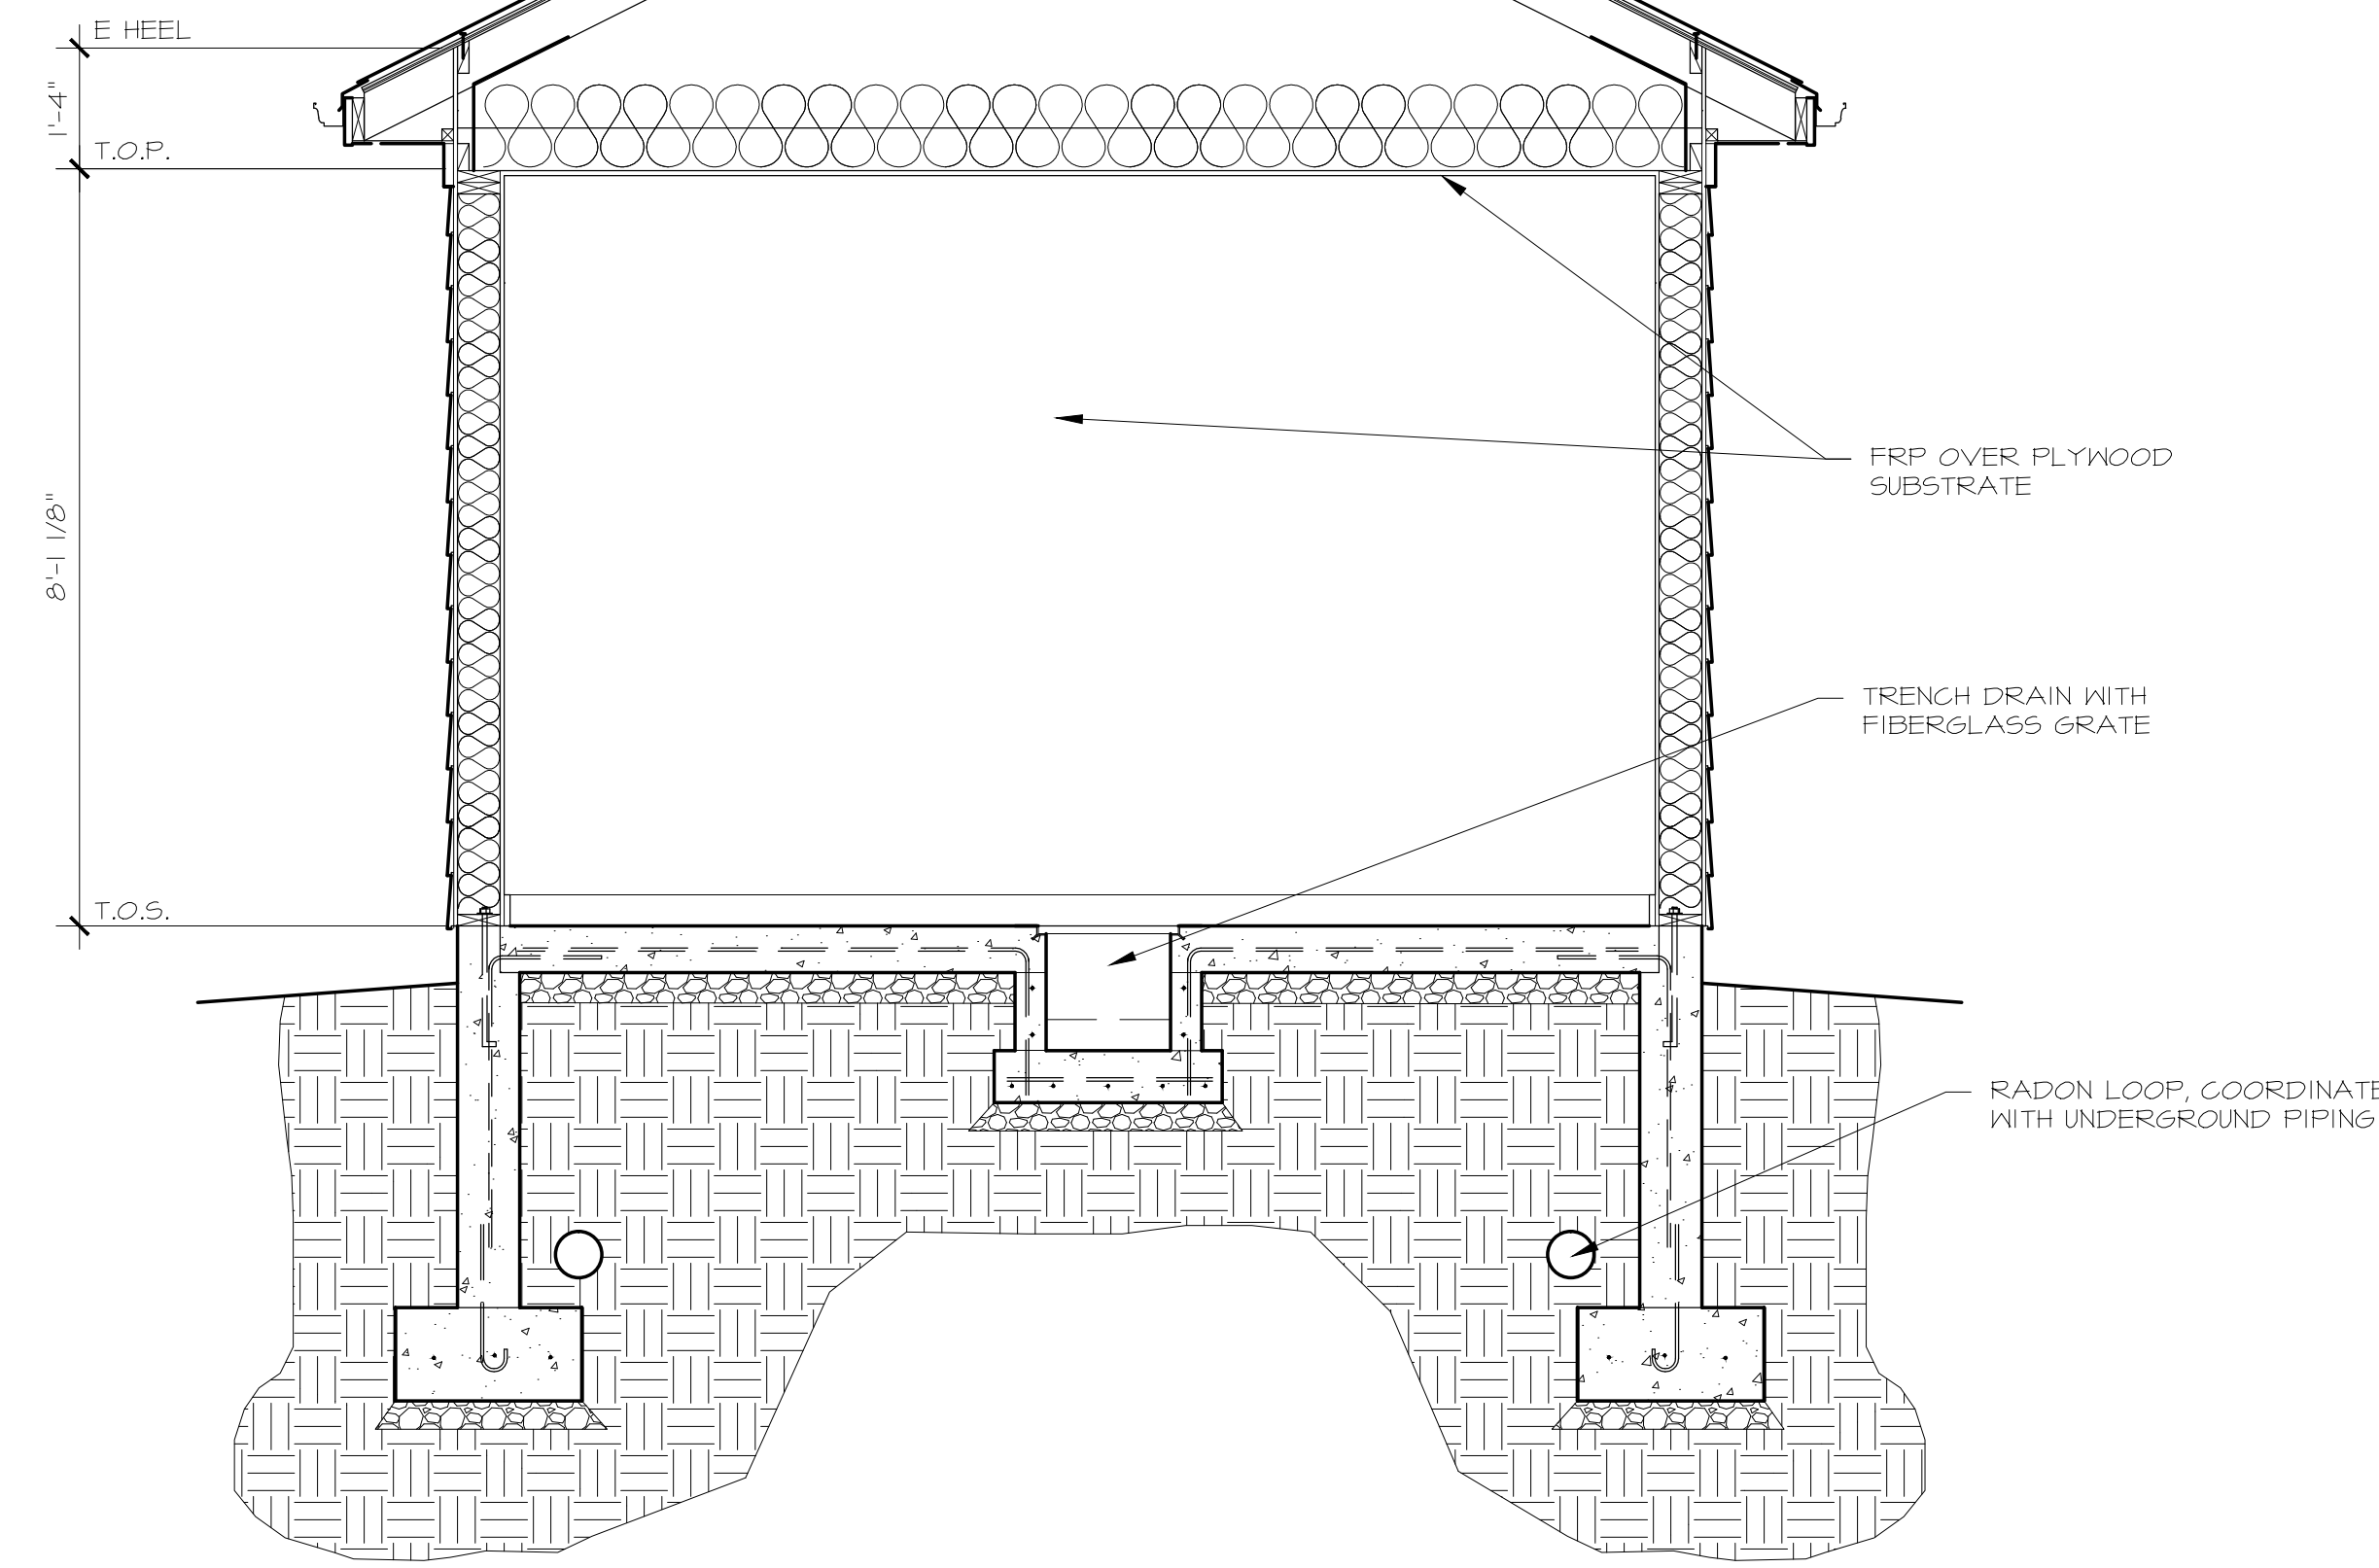

5 BUILDING SECTION

A-5 SCALE: 1/2" = 1'-0"

PLUMBING LINE KEY	
— 3" SAN —	SANITARY SEWER ABOVE GRADE
----- 3" SAN -----	SANITARY SEWER BELOW GRADE
— 2" V —	SEWER VENT ABOVE GRADE
----- 2" V -----	SEWER VENT BELOW GRADE
— 3" G-SAN —	GREASE SANITARY SEWER ABOVE GRADE
----- 3" G-SAN -----	GREASE SANITARY SEWER BELOW GRADE
— 1" DCW —	DOMESTIC COLD WATER UNDER ABOVE GRADE
----- 1" DCW -----	DOMESTIC COLD WATER BELOW GRADE
— 1" DHW —	DOMESTIC HOT WATER ABOVE GRADE
— 1" DHWR —	DOMESTIC HOT WATER RECIRCULATED
— 1" NG —	NATURAL GAS ABOVE GRADE
----- 1" NG -----	NATURAL GAS BELOW GRADE
— 1" LP —	LP GAS ABOVE GRADE
----- 1" LP -----	LP GAS BELOW GRADE

HVAC DUCTING KEY	
12"x10" SA	RECTANGULAR SUPPLY AIR DUCT
12"x10" RA	RECTANGULAR RETURN AIR DUCT
12"x10" EX	RECTANGULAR EXHAUST DUCT
12"x10" OA	RECTANGULAR OUTSIDE AIR DUCT
12"x10" TA	RECTANGULAR TRANSFER AIR DUCT
12"x10" GE	RECTANGULAR GREASE EXHAUST DUCT
12"x10" MP	RECTANGULAR MEDIUM PRESSURE DUCT
12"x10"	RECTANGULAR DUCT (NON-SPECIFIC-REFER TO SYSTEM)
12"x10"	SPECIFICALLY LINED RECTANGULAR DUCT
6"Ø	ROUND DUCT-REFER TO SYSTEM SERVED
6"Ø	ROUND LINED OR DOUBLE WALL DUCT

DUCTWORK SYMBOLS KEY	
	SECTION THROUGH RETURN OR EXHAUST AIR
	SECTION THROUGH SUPPLY OR OUTSIDE AIR DUCT
	SUPPLY, RETURN, EXHAUST, OR OUTSIDE AIR DUCT
	ACCESS DOOR (BOTTOM OR SIDE)
	ACOUSTICALLY LINED DUCT
	DAMPER, FIRE
	DAMPER, MANUAL VOLUME
	INCLINED DROP IN DIRECTION OF ARROW
	INCLINED RISE IN DIRECTION OF ARROW
	TRANSITION, RECTANGULAR TO ROUND
	FLEXIBLE DUCT
	TRANSITION OR OFFSETTING TRANSITION
	TRANSITION, RECTANGULAR
	HIGH EFFICIENCY TAKEOFF WITH DAMPER
	CEILING SUPPLY AIR DIFFUSER ##
	SIDEWALL SUPPLY AIR REGISTER ##
	ELBOW TURNED DOWN
	ELBOW TURNED UP
	ELBOW, RADIUS TYPE
	ELBOW, SQUARE OR RECTANGULAR TYPE WITH 22 GA SINGLE TURNING VANES
	RETURN OR EXHAUST AIR DUCT
	CEILING RETURN AIR REGISTER ##
	SIDEWALL RETURN AIR REGISTER ##
	OPEN END DUCT
	FLEXIBLE CONNECTION

BASIC MECHANICAL/ELECTRICAL/PLUMBING REQUIREMENTS

FURNISH ALL LABOR AND MATERIALS AND PERFORM ALL OPERATIONS NECESSARY FOR THE INSTALLATION OF COMPLETE AND OPERATING MECHANICAL/ELECTRICAL SYSTEMS SUBJECT TO THE CONDITIONS OF THE CONTRACT. PROVIDE SATISFACTORY OPERATION OF ALL EQUIPMENT AND CONTROLS TO THE ARCHITECT/ENGINEER UPON REQUEST.

ALL MATERIALS SHALL BE NEW. SUBSTITUTIONS SHALL BE APPROVED BY OWNER AND/OR ENGINEER.

VISIT THE PREMISES BEFORE SUBMITTING BID AS NO CHANGE ORDERS WILL BE ALLOWED FOR LACK OF KNOWLEDGE OF EXISTING CONDITIONS.

COORDINATE AND ORDER THE PROGRESS OF WORK TO CONFORM TO THE PROJECT SCHEDULE AND THE PROGRESS OF THE WORK OF THE OTHER TRADES.

MECHANICAL/ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND BECAUSE OF THE SMALL SCALE, IT IS NOT POSSIBLE TO INDICATE EVERY REQUIRED OFFSET, FITTING, ETC. VERIFY ALL SPACE REQUIREMENTS, COORDINATING WITH OTHER TRADES, AND INSTALL THE SYSTEMS IN THE SPACE PROVIDED WITHOUT EXTRA CHARGES TO THE OWNER.

PERFORM WORK IN ACCORDANCE WITH GOOD COMMERCIAL PRACTICE. THE GOOD APPEARANCE OF THE FINISHED WORK SHALL BE OF EQUAL IMPORTANCE WITH ITS MECHANICAL/ELECTRICAL EFFICIENCY AND INTENT. THE OWNER MAY REJECT WORK IF WORKMANSHIP AND APPEARANCE ARE NOT SATISFACTORY.

INSTALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH THE MANUFACTURERS' RECOMMENDATIONS UNLESS SPECIFICALLY INDICATED OTHERWISE, OR WHERE LOCAL CODES OR REGULATIONS TAKE PRECEDENCE.

COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AND ORDINANCES. COMPLY WITH REQUIREMENTS OF THE UTILITY COMPANIES. IN THE CASE OF DIFFERENCES BETWEEN THESE REQUIREMENTS AND ORDINANCES, THE MOST STRINGENT SHALL GOVERN. CALL FOR INSPECTIONS REQUIRED BY LOCAL BUILDING INSPECTION AUTHORITY.

PLANS AND SPECIFICATIONS GO HAND IN HAND. WHAT IS REQUIRED IN ONE IS REQUIRED IN BOTH. WHERE CONFLICTS BETWEEN SPECIFICATIONS AND PLANS EXIST, THE MOST STRINGENT REQUIREMENTS SHALL APPLY.

MECHANICAL/ELECTRICAL PLANS SUPERCEDE ARCHITECTURAL PLANS. BACKGROUND FLOOR PLANS USED FOR MECHANICAL/ELECTRICAL DRAWINGS MAY SHOW DIFFERENT THAN THE FINAL ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURAL DRAWINGS FOR ACTUAL DIMENSIONS AND LAYOUT PLACEMENTS FOR SPACE CONDITIONS.

MECHANICAL AND ELECTRICAL DETAILS MAY OR MAY NOT BE DIRECTLY REFERENCED. ALL DETAILS SHOWN ARE TO BE USED FOR BASIS OF INSTALLATION IN ALL CASES, IN COORDINATED EFFORT WITH MANUFACTURERS INSTALLATION RECOMMENDATIONS.

MECHANICAL SHEETS ARE NOT INTENDED TO SPECIFICALLY BE TRADE SPECIFIC TO MECHANICAL INSTALLATION WORK. ELECTRICAL SHEETS ARE NOT INTENDED TO SPECIFICALLY BE TRADE SPECIFIC TO ELECTRICAL INSTALLATION WORK. ALL MECHANICAL AND ELECTRICAL TRADES ARE RESPONSIBLE FOR FAMILIARIZING THEMSELVES AND INCLUDING A COMPLETE PACKAGE WITHIN THEIR OFFER FOR A COMPLETE SYSTEM.

AT COMPLETION OF WORK, DELIVER COMPLETED PROJECT RECORD DOCUMENTS MARKED WITH FIELD CHANGES TO OWNER.

PROVIDE A WRITTEN WARRANTY TO THE OWNER COVERING THE ENTIRE ELECTRICAL/MECHANICAL WORK TO BE FREE FROM DEFECTIVE MATERIALS, EQUIPMENT AND WORKMANSHIP FOR A PERIOD OF 1 YEAR AFTER DATE OF ACCEPTANCE.

CLEAN EXPOSED SURFACES OF LIGHT FIXTURES, SWITCHGEAR, FURNACES, HOT WATER HEATERS, PLUMBING FIXTURES AND OTHER EXPOSED ITEMS OF GREASE, DIRT OR OTHER FOREIGN MATERIAL. REMOVE RUBBISH AND DEBRIS RESULTING FROM THE OPERATIONS AND LEAVE EQUIPMENT SPACES CLEAN AND READY FOR USE.

MAINTAIN ALL CEILING, FLOOR AND WALL FIRE AND SMOKE PROTECTION RATINGS. SEAL ALL CONDUIT AND ENCLOSURE PENETRATIONS TO COMPLY WITH UL ASSEMBLY AND BUILDING CODE REQUIREMENTS. ALL SEALANTS AND CONSTRUCTIONS SHALL BE APPROVED BY OWNER PRIOR TO APPLICATION. ALL OPENINGS SHALL BE SEALED DAILY.

CONTRACT DRAWINGS FOR MECHANICAL/ELECTRICAL WORK ARE IN PART DIAGRAMMATIC, INTENDED TO CONVEY THE SCOPE OF WORK AND INDICATE GENERAL ARRANGEMENT OF EQUIPMENT, CONDUITS, AND APPROXIMATE SIZES AND LOCATIONS OF EQUIPMENT AND OUTLETS. MECHANICAL/ELECTRICAL TRADES SHALL FOLLOW THESE DRAWINGS IN LAYING OUT THEIR WORK. CONSULT GENERAL CONSTRUCTION DRAWINGS TO FAMILIARIZE THEMSELVES WITH ALL CONDITIONS AFFECTING THEIR WORK, AND SHALL VERIFY SPACES IN WHICH THEIR WORK WILL BE INSTALLED. COORDINATE WORK WITH OTHER TRADES AND AS PROJECT CONDITIONS REASONABLY REQUIRE WITHOUT EXTRA COSTS TO OWNER.

ELECTRICAL SPECIFIC:
RACEWAYS SHALL BE LEFT WITH 30% FREE SPACE FOR FUTURE NEEDS.

SHARING OF NEUTRALS BETWEEN PHASES SHALL NOT BE ALLOWED.

SEPARATE GROUNDING CONDUCTORS SHALL BE PROVIDED IN ALL RACEWAYS.

CONDUCTORS SHALL BE COPPER. COLOR CODING SHALL BE NEC APPROVED AND AT MINIMUM SHALL BE AS FOLLOWS:
120/208 VOLT-BLACK, RED, BLUE FOR PHASE CONDUCTORS, WHITE FOR NEUTRAL CONDUCTORS, 277/480 VOLT-BROWN, ORANGE, YELLOW FOR PHASE CONDUCTORS, GRAY FOR NEUTRAL CONDUCTORS. GROUNDING CONDUCTORS SHALL BE GREEN.

ELECTRICAL SYSTEMS SHALL COMPLY WITH 2014 NATIONAL ELECTRICAL CODE AND BE INSTALLED BY LICENSED CONTRACTORS. LIGHTING SHALL COMPLY WITH THE 2012 IECC.

HVAC SPECIFIC:
ALL DUCTWORK DIMENSIONS, AS SHOWN ON THE DRAWINGS, ARE INTERNAL CLEAR DIMENSIONS AND DUCT SIZE SHALL BE INCREASED TO COMPENSATE FOR DUCT LINING THICKNESS.

PROVIDE ALL 90 DEGREE SQUARE ELBOWS WITH SINGLE RADIUS TURNING VANES UNLESS OTHERWISE INDICATED.

COORDINATE DIFFUSER, REGISTER, AND GRILLE LOCATIONS WITH ARCHITECTURAL REFLECTED CEILING PLANS, LIGHTING, AND OTHER CEILING ITEMS AND MAKE DUCT MODIFICATIONS TO SUIT.

AT CONTRATORS OPTION, FLEXIBLE DUCT MAY BE USED TO CONNECT SUPPLY REGISTERS AND DIFFUSERS ON THIS PROJECT ONLY. RUNS OF FLEXIBLE DUCT SHALL NOT EXCEED 5 FEET, UNLESS SPECIFICALLY SHOWN ON DRAWING.

ALL DUCTWORK SHALL BE COORDINATED WITH ALL TRADES INVOLVED. OFFSETS IN DUCTS, INCLUDING DIVIDED DUCTS AND TRANSITIONS AROUND OBSTRUCTIONS, SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.

MECHANICAL SYSTEMS SHALL COMPLY WITH INTERNATIONAL MECHANICAL CODE VER 2012 AND INTERNATIONAL ENERGY CODE VER 2012.

PLUMBING/PIPING SPECIFIC:
PLUMBING/PIPING SYSTEMS SHALL COMPLY WITH INTERNATIONAL FUEL GAS CODE VER 2012 AND UNIFORM PLUMBING CODE VER 2012.

UTILITIES:
LOCATION OF UNDERGROUND UTILITIES ARE APPROXIMATE. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO DETERMINE EXACT LOCATIONS IN THE FIELD (NOT ALL UTILITIES ARE SHOWN).

REGULATORY AND CODE REQUIREMENTS:
APPLY FOR AND PAY FOR ALL PERMITS, FEES, LICENSES AND INSPECTIONS. ALL WORK IS SUBJECT TO APPROVAL BY THE CODE OFFICIAL AND ENGINEER. ALL CORRECTIONS SHALL BE MADE WITHOUT EXTRA COSTS TO OWNER.

HVAC CONTROL SYMBOLS			
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	GATE, BALL, OR FUEL SOV VALVE		ROOM OR ZONE THERMOSTAT
	GLOBE VALVE		DUCT THERMOSTAT
	GAS COCK		THERMOMETER WITH WELL
	SOLENOID VALVE		PRESSURE GAGE WITH SHUTOFF
	CONTROL VALVE, 2-WAY		DAMPER
	PRESSURE REDUCING VALVE		SMOKE DETECTOR
	CHECK VALVE		FLOW SWITCH
	PLUG VALVE		FLOW SWITCH
	EXPANSION VALVE		FIRE SAFETY SWITCH
	PRESS./TEMP. RELIEF VALVE		HUMIDISTAT, ROOM
	CONTROL VALVE, 3-WAY		HUMIDISTAT, DUCT
	STRAINER, CAST IRON OR BRONZE		PRESSURE SWITCH
	STRAINER WITH BLOW DOWN & PLUG		DAMPER ACTUATOR
	1/4 TURN BOILER DRAIN W/CAP		FLOW SWITCH
	NG OR LP EQUIPMENT REGULATOR		TEMPERATURE TRANSMITTER (SENSOR)
	FLEXIBLE PIPE CONNECTOR		PRESSURE TRANSMITTER OR SWITCH
	STEAM TRAP		DIFFERENTIAL PRESSURE CONTROLLER
	MOTOR		AUTO AIR VENT, EXTEND TO DRAIN
	PUMP		MANUAL BALANCING VALVE
	CENTRIFUGAL FAN		AUTOMATIC BALANCING VALVE

ELECTRICAL HARDWARE

CONDUIT & RACEWAYS SHALL BE CONCEALED AND APPROVED FOR USE AND LOCATION.

DRY LOCATIONS - GRC, IMC, EMT.
UNDERGROUND - GRC, PVC.
FLEXIBLE CONDUIT - ALLOWED ONLY FOR CONNECTION OF EQUIPMENT AND LIMITED TO LENGTHS OF SIX FEET, GALVANIZED, LIQUID TIGHT. MC OR AC ALLOWED WHEN PROTECTED.
PROVIDE SEPARATE EQUIPMENT GROUNDING CONDUCTOR IN CONDUIT.
NOT ALLOWED.

NM-B CABLE

JUNCTION AND PULL BOXES:
DRY LOCATIONS - STEEL WITH COVERS.
WET LOCATIONS - CAST ALUMINUM.
SIZE PER NEC.

COUPLINGS AND CONNECTORS:

GRC - THREADED
IMC - THREADED
EMT - DRY-COMPRESSION OR SET SCREW, BOTH OF STEEL, WET-RAIN TIGHT
PVC - CEMENT JOINT TYPE
INDENTER TYPE CONNECTORS PROHIBITED.

CABELING DEVICES AND PLATES:

DUPLEX OUTLETS - HUBBELL #CR20 SERIES, 20 AMP (OR APPROVED EQUAL)
GFCI OUTLETS - HUBBELL #GFC20 SERIES, 20 AMP (OR APPROVED EQUAL)
AC SWITCHES - HUBBELL #CS120 SERIES (OR APPROVED EQUAL)
FOR 3 WAY OR 4 WAY USE EQUIVALENT
DEVICE COLOR - COORDINATE COLOR W/ OWNER OR ARCHITECT
PLATES - NYLON, COORDINATE COLOR W/ OWNER OR ARCHITECT
OCCUPANCY SENSORS - HUBBELL #WS120W (OR APPROVED EQUAL)

ANCHORS:
HOLLOW MASONRY - TOGGLE BOLT.
SOLID MASONRY - EXPANSION BOLT.
STEEL - METAL MACHINE SCREWS, BOLTS.
WOOD - WOOD SCREWS.

P.C. PLUMBING CONTRACTOR
M.C. MECHANICAL CONTRACTOR
E.C. ELECTRICAL CONTRACTOR

MOUNTING HEIGHTS

DESCRIPTION	HEIGHT UNLESS OTHERWISE NOTED
THERMOSTAT, CONTROLLER	48"
WALL SWITCH/ OCCUPANCY SENSOR	46"
CONVENIENCE OUTLET	18"
WALL SWITCHES	46"
TELEPHONE/DATA/TV OUTLETS	18"
FIRE ALARM MANUAL STATION	42"
FIRE ALARM HORNS & STROBES	90" A.F.F.-6" BELOW CEILING
EXIT SIGN	CENTER, 4" ABOVE DOOR
MANUAL MOTOR STARTER SWITCH	42"
PANELBOARDS, CABINETS	72"
MOUNTING HEIGHTS TO TOP OF BOX AND ABOVE FINISHED FLOOR GRADE UNLESS NOTED OTHERWISE. MATCH EXISTING MOUNTING HEIGHTS WHICH COMPLY WITH ADA REQUIREMENT.	

ELECTRICAL LEGEND

SYMBOL	DESCRIPTION
	DUPLEX OUTLET, STANDARD HEIGHT/COORD ELEV.
	DOUBLE DUPLEX RECEPTACLE
	GROUND FAULT CIRCUIT INTERRUPTER OUTLET
	220 VOLT RECEPTACLE
	WEATHER PROOF OUTLET WITH COVER W/ GFCI
	DUPLEX OUTLET, ELEVATION CALLOUT
	JUNCTION BOX
	BRANCH CIRCUIT PANEL
	FUSED DISCONNECT SWITCH
	COMBINATION MOTOR STARTER / DISCONNECT
	STARTER/CONTACTOR
	THERMOSTAT
	SWITCH, WIND UP TIMER
	SWITCH, PILOT DUTY/CONTROL LEG CONTACTOR
	SWITCH, SPST
	SWITCH, SPDT
	SWITCH, 3-WAY
	SWITCH, 4-WAY
	SWITCH, OCCUPANCY SENSOR-DUAL TECHNOLOGY
	SWITCH, OCCUPANCY SENSOR-MOTION DETECTOR
	OCCUPANCY SENSOR, CEILING
	SWITCH, PHOTOCELL WITH REMOTE CONTROLLER
	SWITCH, OCCUPANCY SENSOR-DUAL TECHNOLOGY
	FIRE ALARM STROBE
	FIRE ALARM HORN/STROBE
	FIRE ALARM SMOKE DETECTOR
	FIRE ALARM HEAT SENSOR
	FIRE ALARM DUCT SMOKE DETECTOR
	FIRE ALARM PULL STATION
	FIRE ALARM DOOR HOLD
	EXIT LIGHT FIXTURE
	EXIT LIGHT FIXTURE WITH DIRECTIONAL ARROW
	EMERGENCY LIGHT FIXTURE WITH EXIT SIGN
	EMERGENCY LIGHT FIXTURE
	TELEPHONE/DATA OUTLET
	TELEPHONE OUTLET
	CEILING LIGHT OUTLET
	WALL LIGHT OUTLET
	CIRCUIT HOMERUN
	REPRESENTS EXISTING CONDITION

GENERAL CONSTRUCTION NOTES

ALL WORK PERFORMED IN CONJUNCTION WITH THESE DRAWINGS SHALL MEET ALL CURRENT APPLICABLE BUILDING AND ENERGY CODES.

ALL WORK PERFORMED IN CONJUNCTION WITH THESE DRAWINGS IS SUBJECT TO APPROVAL BY THE AUTHORITY HAVING JURISDICTION (CODE OFFICIAL).

ALL ROOF PENETRATIONS SHALL BE PATCHED AND SEALED, WITH WARRANTY FROM BUILDING ROOFING CONTRACTOR.

ALL NEW AND ALTERED LIGHTING SHALL BE SECURELY FASTENED TO GRID AND SHALL BE SEISMICALLY SUPPORTED AS PER APPLICABLE BUILDING CODES.

THIS SET OF DOCUMENTS IS INTENDED FOR A/HJ REVIEW AND SHALL BE CONSIDERED AS CONSTRUCTION DOCUMENTS. IT SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE ALL CONDITIONS, EXISTING AND/OR NEW, OF THE SITE AS WELL AS LOCATIONS, QUANTITIES, TYPE AND STYLE OF ALL PRODUCTS PROVIDED, WITH OWNER, PRIOR TO ORDERING OR INSTALLING.


CONSTRUCTION DOCUMENT

Dawes Engineering & Design

46 Hibbard Way
Helena, MT 59601

(406) 441-4000 p

THESE PLANS ARE INSTRUMENTS OF PROFESSIONAL SERVICES AND ARE PROTECTED BY COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS INCLUDING COPYRIGHT. DRAWINGS MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF DAWES ENGINEERING & DESIGN COMPANY.

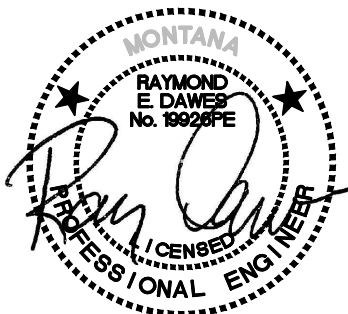

WASHOE HATCHERY ADDITION

**600 W PENNSYLVANIA AVE
ANACONDA, MT 59711**

SHEET CONTENTS:

ISSUE DATE: APRIL 29, 2016
DATE: APRIL 29, 2016
DRAWN BY: PM
CHECKED BY: RD


REV # X
REV DATE: XXXX/XXX

REV #

SHEET NUMBER


ME 0.0

**MEP
COVER
SHEET**

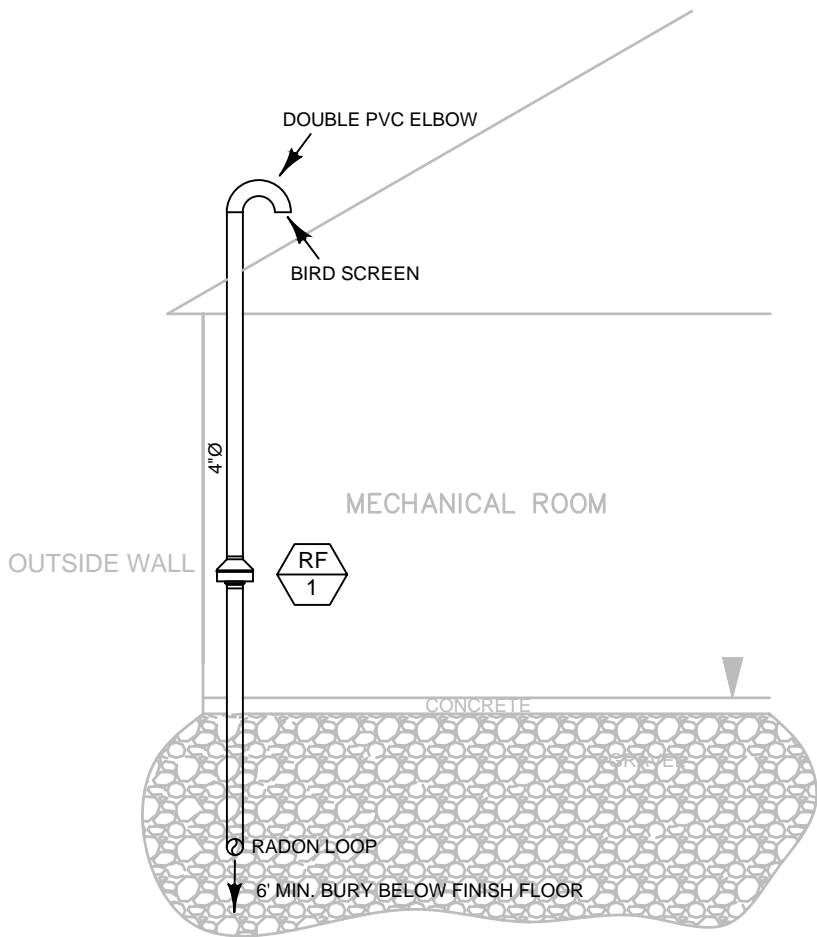


1 HVAC SECTION VIEW - RADON VENTILATION
M1.0 SCALE: 1/4"=1'

GRD ID SCHEDULE			
TAG	STYLE	CFM	NECK SIZE
01	RG-1	-	10" X 10"

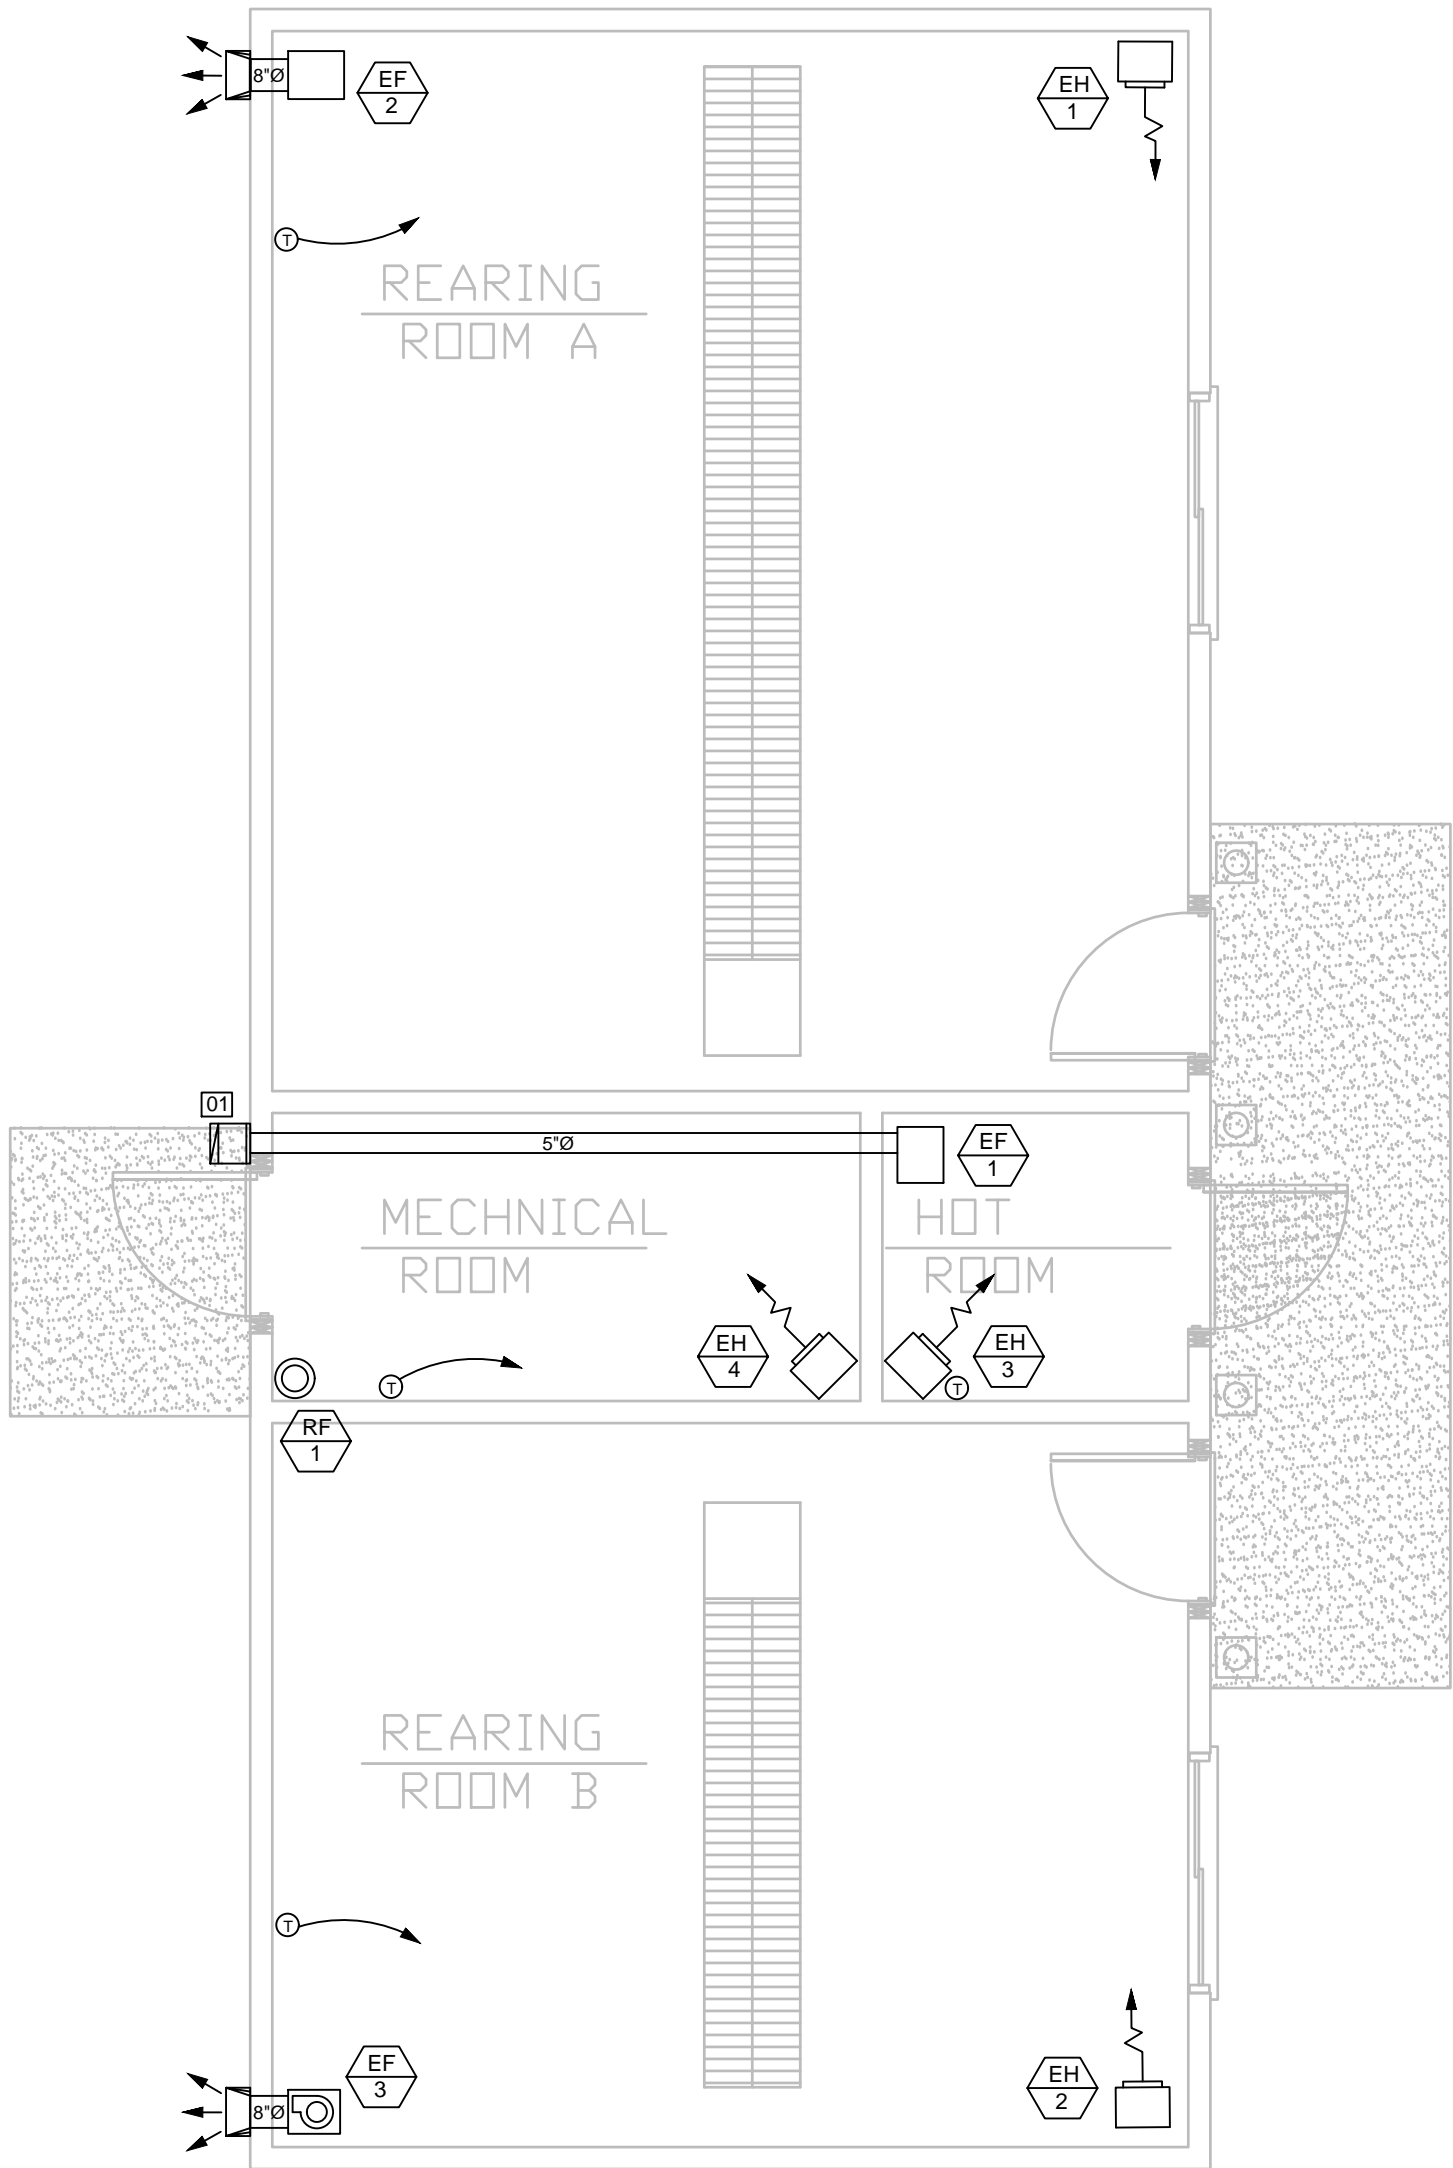


2 NEW HVAC FLOOR PLAN
M1.0 SCALE: 1/4"=1'

CONSTRUCTION DOCUMENT	
<div>Dawes Engineering & Design</div> <div>46 Hibbard Way Helena, MT 59601</div> <div>(406) 441-4000 p</div>	
<div>THESE PLANS ARE INSTRUMENTS OF PROFESSIONAL SERVICES AND ARE PROTECTED BY COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS INCLUDING COPYRIGHT. DRAWINGS MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF DAWES ENGINEERING & DESIGN COMPANY.</div>	<div>STATE OF MONTANA E DAWES No. 56626 PROFESSIONAL ENGINEER</div>
WASHOE HATCHERY ADDITION	
600 W PENNSYLVANIA AVE ANACONDA, MT 59711	
SHEET CONTENTS: NEW HVAC PLAN	ISSUE DATE: DATE: APRIL 29, 2016 DRAWN BY: PM CHECKED BY: RD
	REV # X REV DATE: XXXX/XXX
	REV #
	SHEET NUMBER M1.0

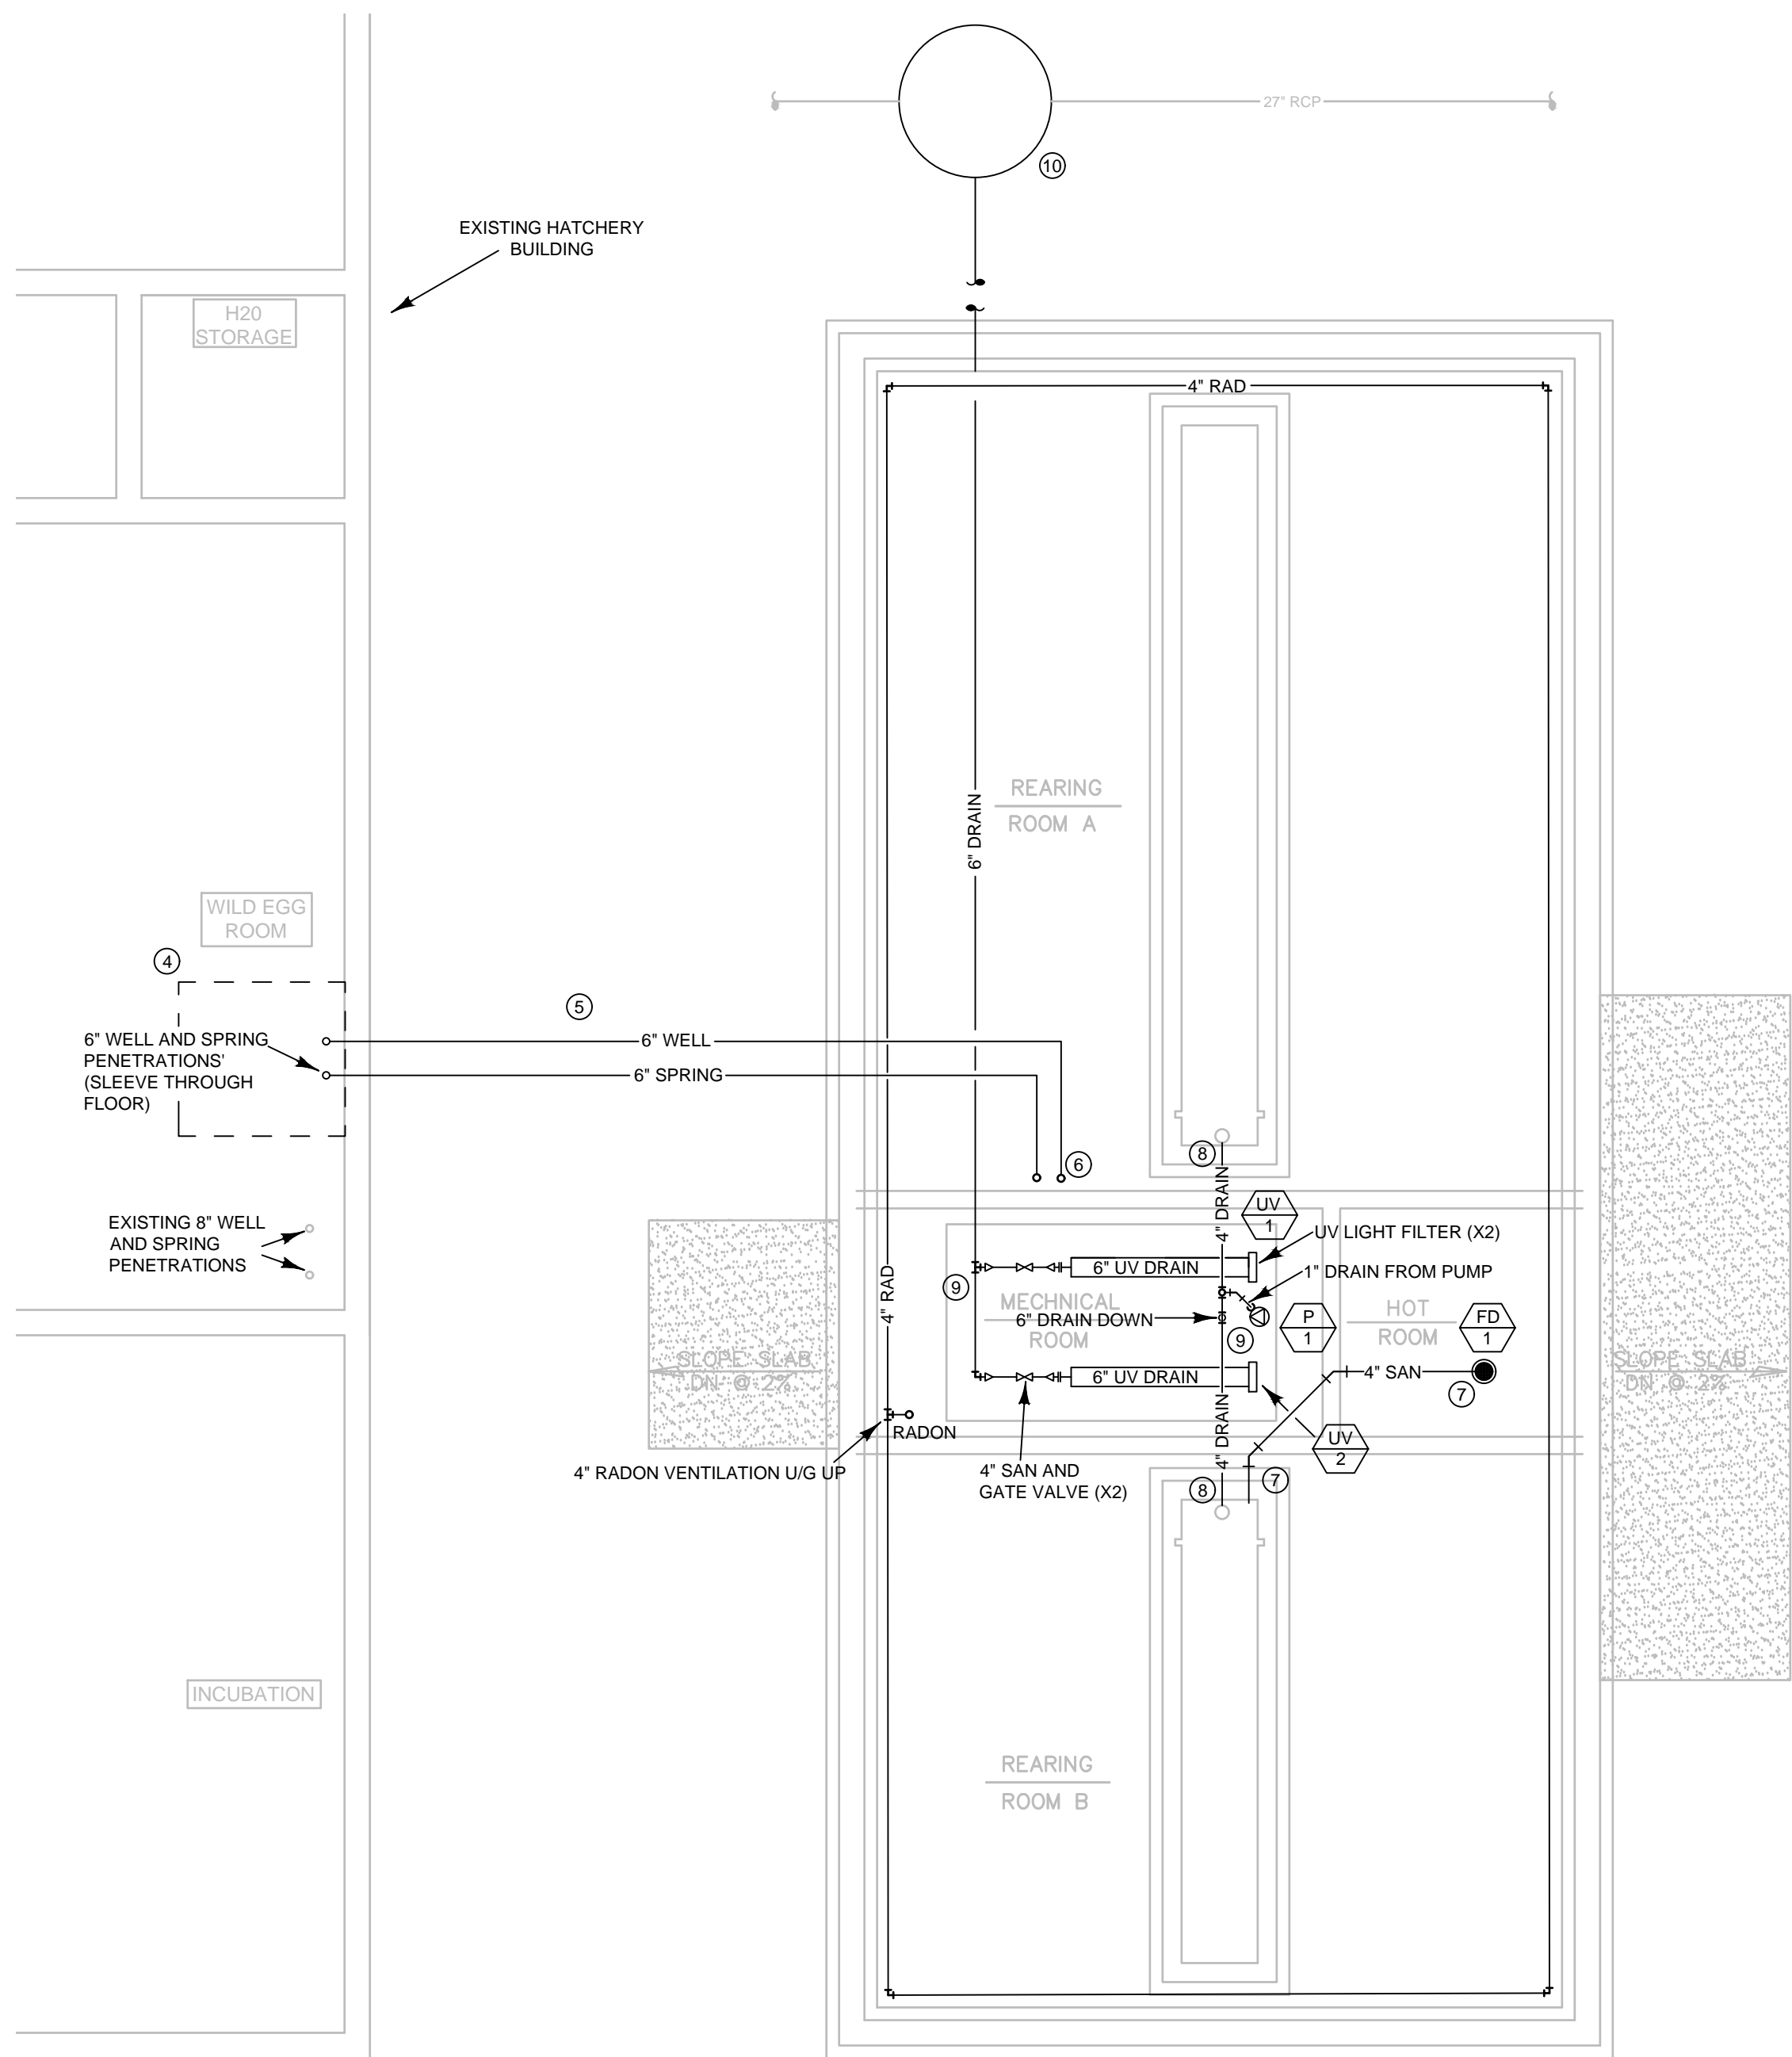


1 NEW MECHANICAL PIPING FLOOR PLAN - BELOW GRADE
M2.0 SCALE: 1/4"=1'

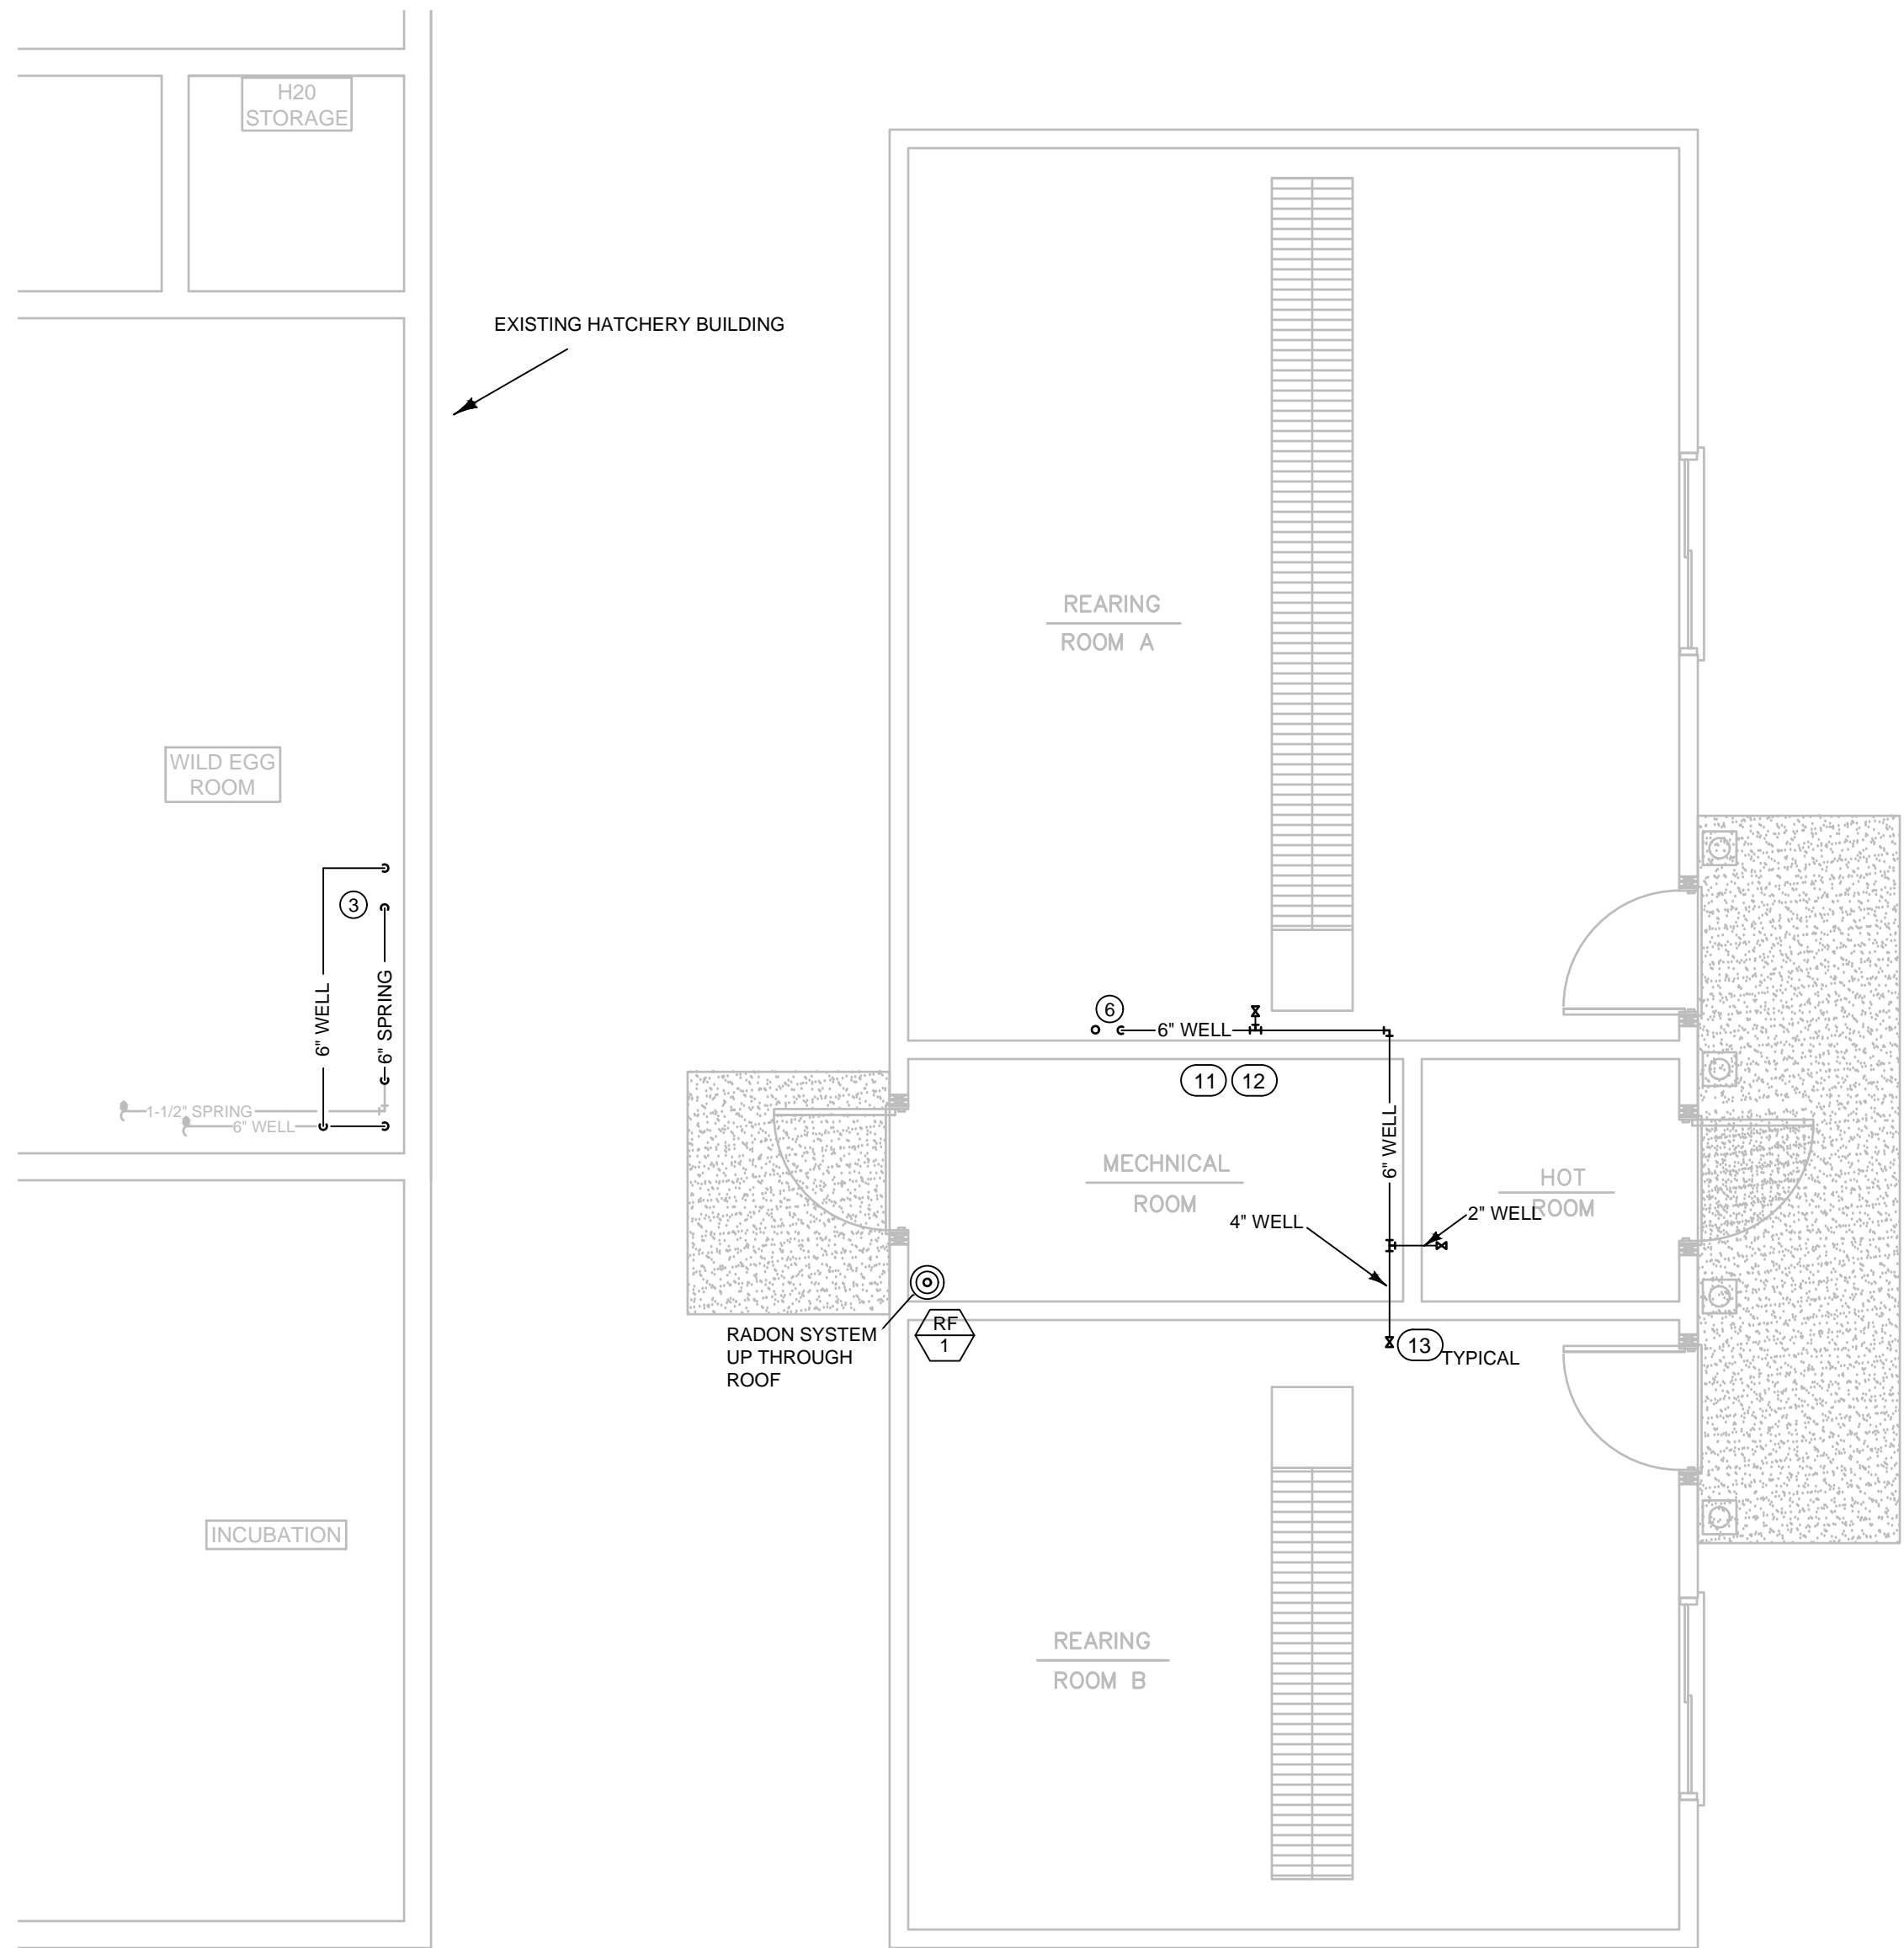


2 NEW MECHANICAL PIPING FLOOR PLAN - ABOVE GRADE
M2.0 SCALE: 1/4"=1'

- KEYED PLUMBING NOTES**
- 1 REMOVE ELBOW AND PREP FOR PIPING EXTENSION WITH A TEE.
 - 2 ADD PIPING AND FITTINGS SHOWN IN BOLD. REDUCERS NOT SHOWN FOR CLARITY. USE CONCENTRIC REDUCERS.
 - 3 INSTALL NEW 6" WELL AND SPRING PIPING MAX 5' AFF.
 - 4 CUT CONCRETE FLOOR FOR NEW 6" PIPING INSTALLED BELOW GRADE.
 - 5 INSTALL NEW 6" WELL AND SPRING LINES UNDERGROUND TO NEW REARING ROOM A. BED WITH SAND. BRIDGE WITH GRAVEL AND COMPACT BACKFILL. 6' 6" MINIMUM BURY.
 - 6 NEW 6" WELL AND SPRING LINES UP THROUGH FLOOR OF REARING ROOM A. SLEEVE PENETRATIONS THROUGH FLOOR WITH 5 GALLON BUCKETS. VALVE TO BE 3' AFF MINIMUM.
 - 7 FLOOR DRAIN IN HOT ROOM TO DRAIN INTO TROUGH IN REARING ROOM B.
 - 8 TROUGHS IN REARING ROOMS A & B TO DRAIN INTO SUMP IN MECHANICAL ROOM.
 - 9 UV DISINFECTION SYSTEM, SUMP PUMP, AND PIPING LOCATED IN MECHANICAL ROOM SUMP. SEE SUMP AND SUMP PUMP DETAILS ON M3.0.
 - 10 6" DRAIN TO CONNECT TO 27" RCP DRAIN PIPE WITH NEW 48"Ø MANHOLE.
 - 11 INSTALL SPRING PIPING SIMILAR (NOT SHOWN ON PLANS) AS WELL PIPING. SLEEVE AND SEAL ALL WALL PENETRATIONS WITH PVC AND 100% SILICONE. MOUNT PIPING HORIZONTALLY 48" AFF.
 - 12 MOUNT ALL INDOOR PIPING ON STRUT SECURED TO WALL AND CLAMPS.
 - 13 VALVES TO BE APOLLO MODEL 215LxkSP2FA1, OR EQUAL LUG STYLE VALVES. PROVIDE FLANGES AND BARE PVC CONNECTION ON OUTLET FOR FWP STAFF TO CONNECT OWNER PROVIDED CONNECTIONS.

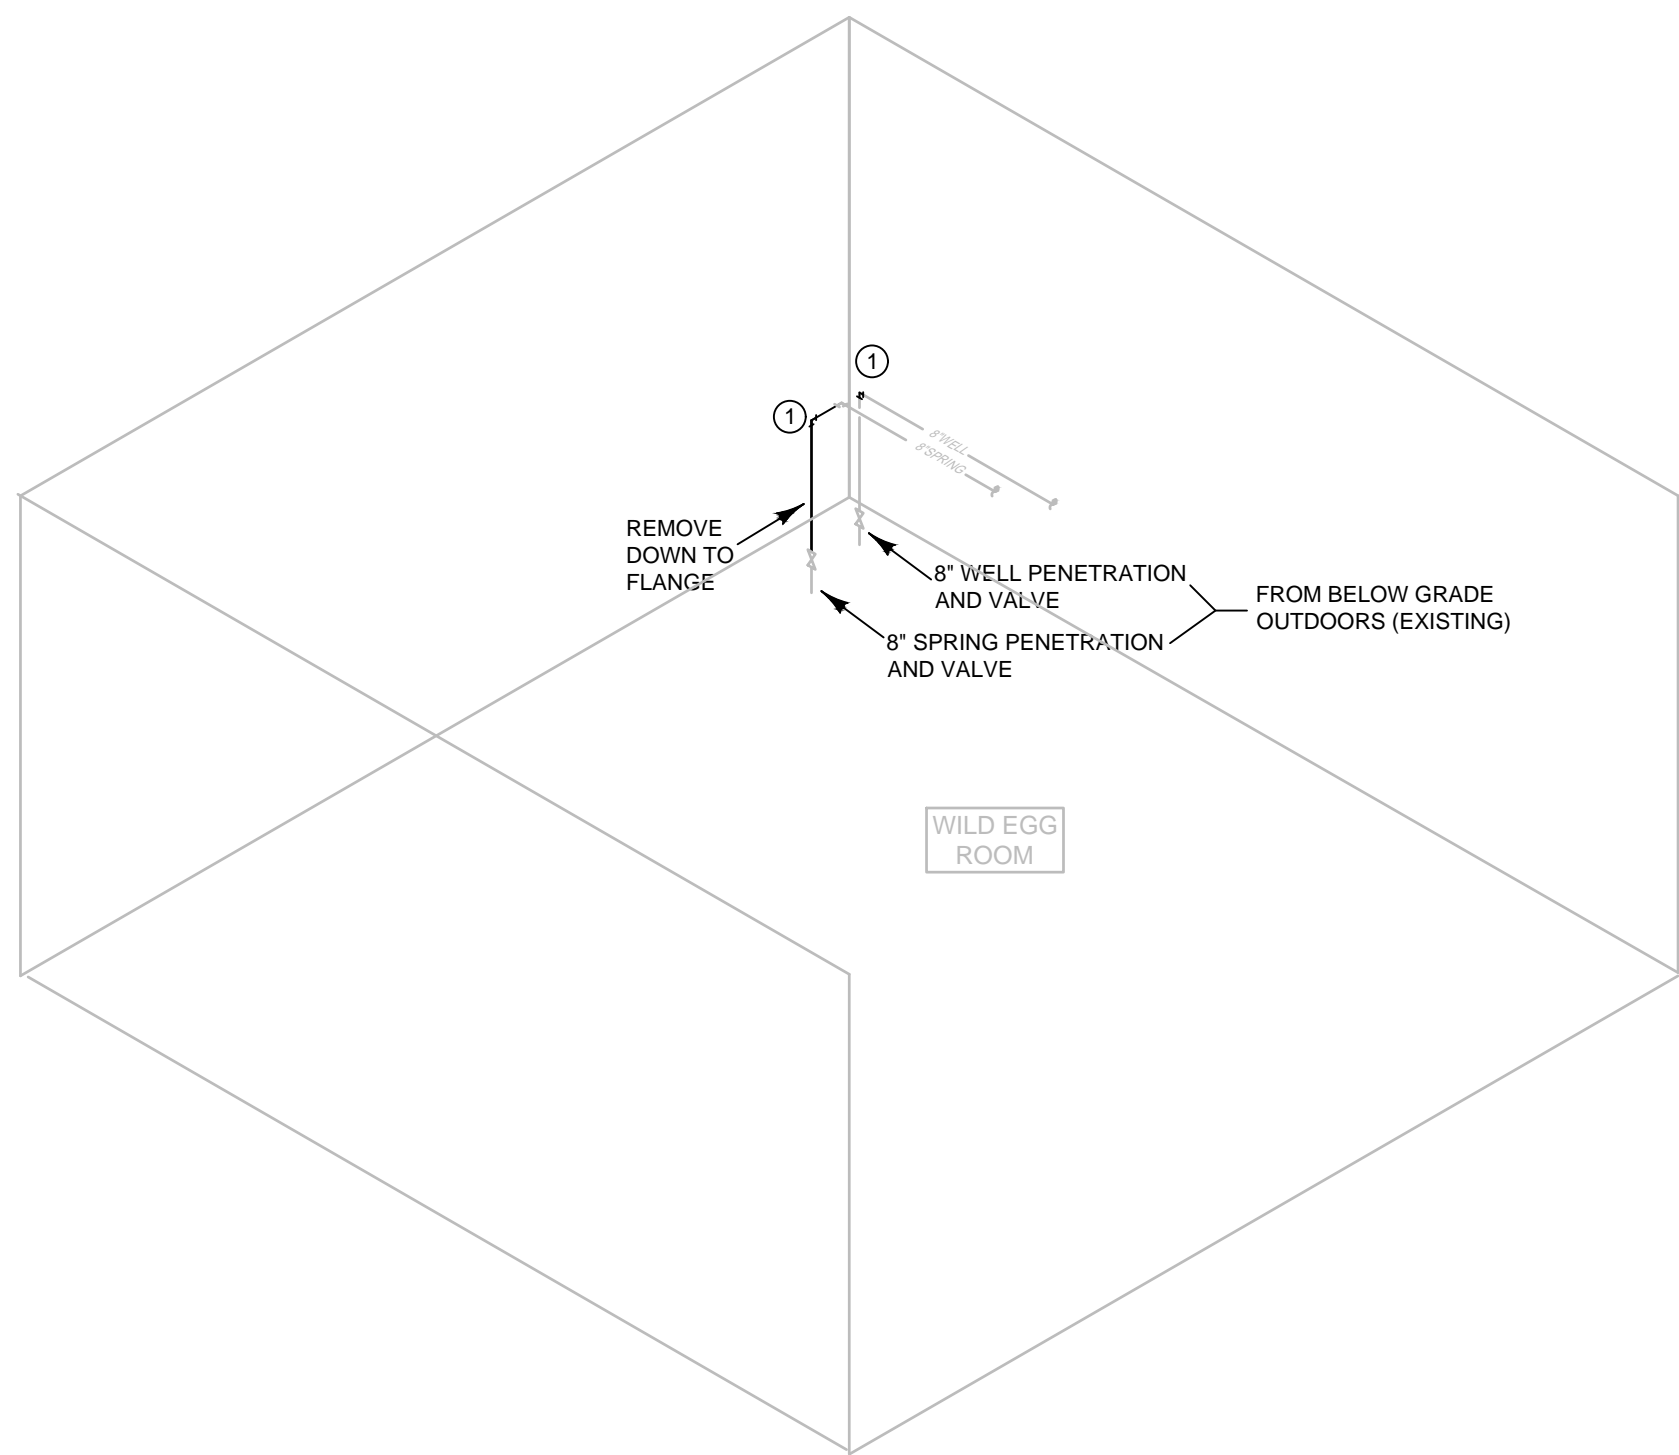

3 3-D HATCHERY BUILDING PIPING DEMOLITION PLAN
M2.0 SCALE: NTS

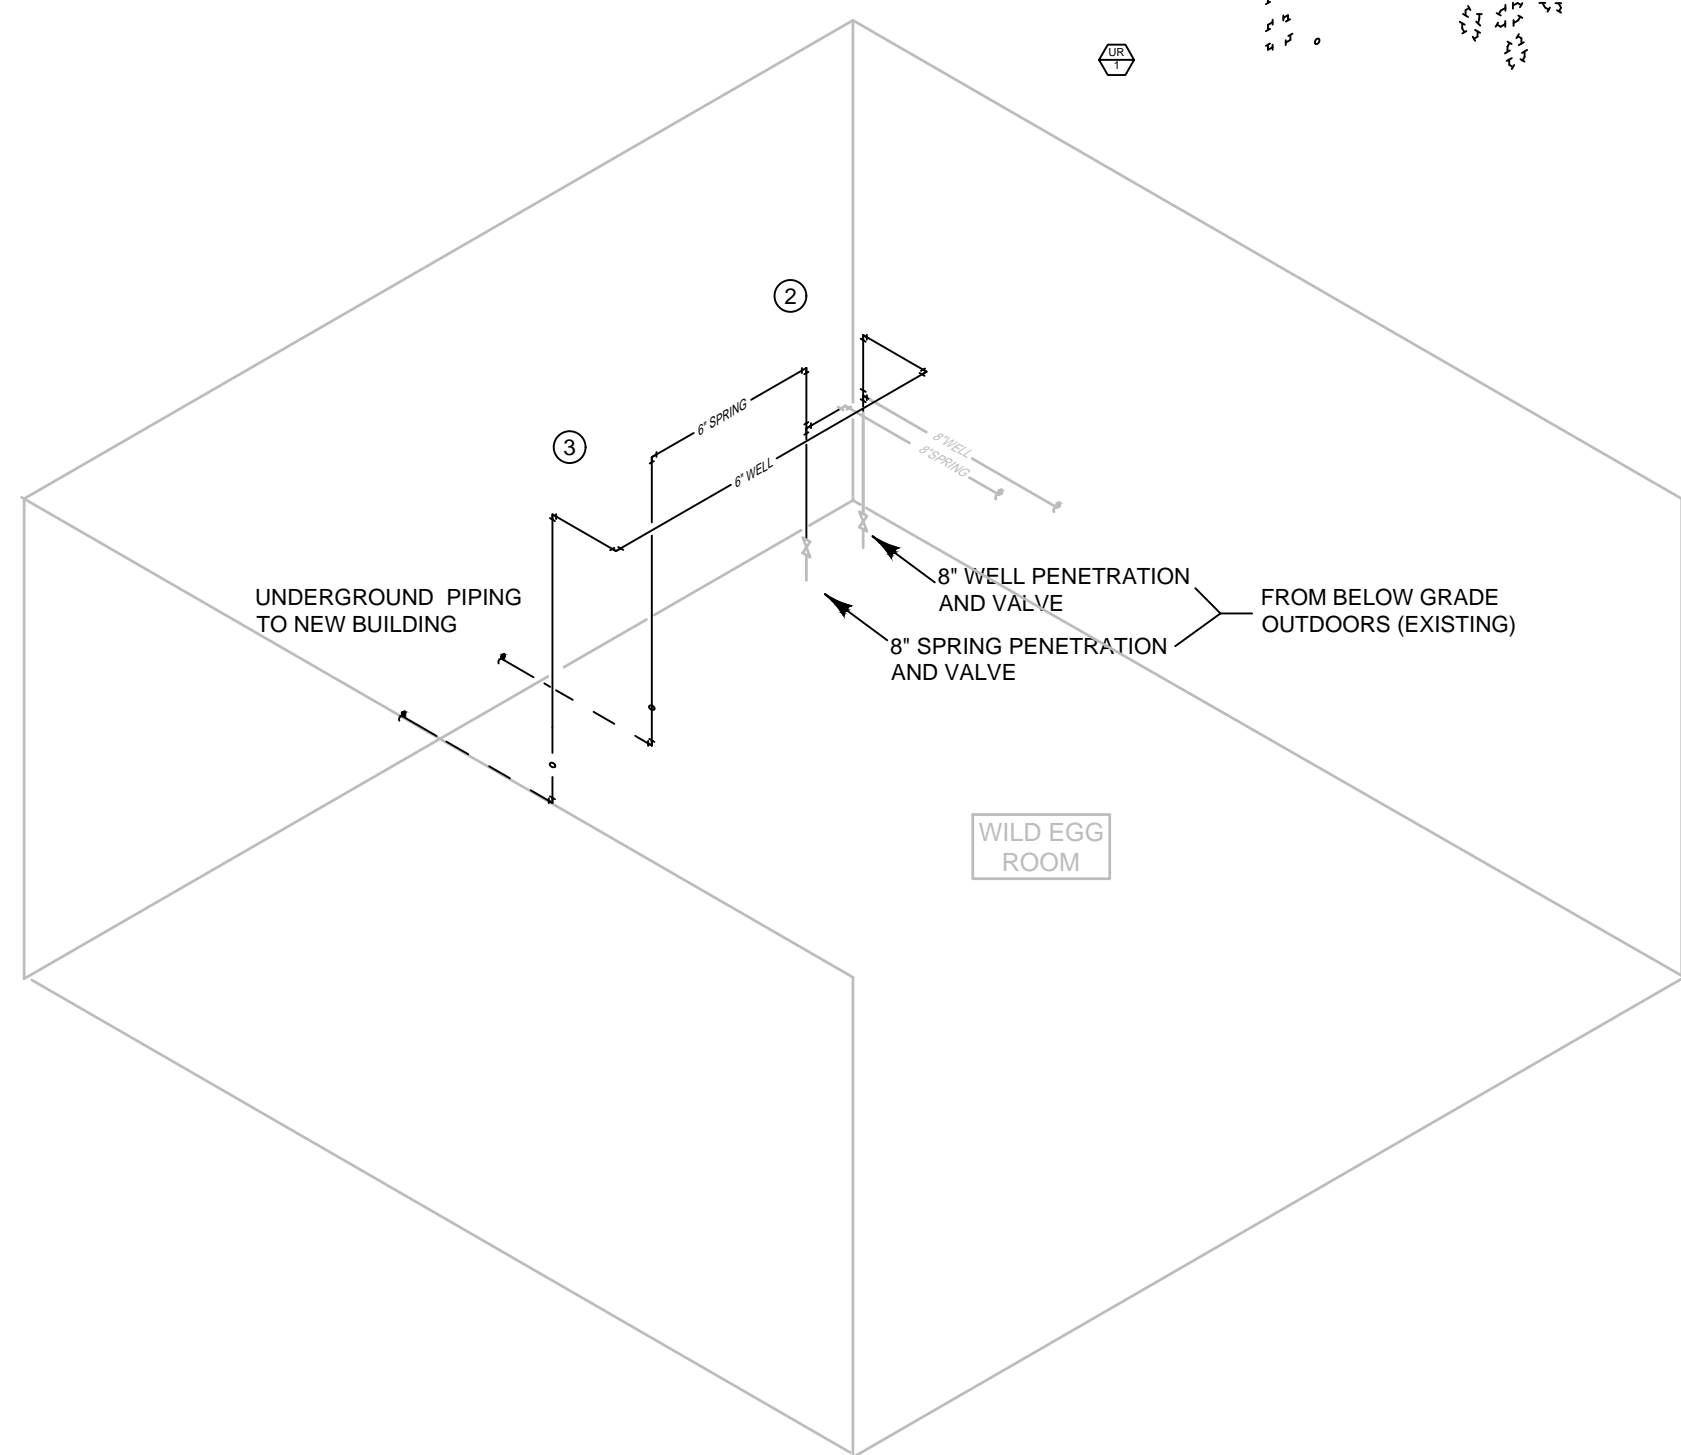


4 3-D HATCHERY BUILDING NEW PLUMBING PLAN
M2.0 SCALE: NTS

CONSTRUCTION DOCUMENT

Dawes Engineering & Design

46 Hibbard Way
Helena, MT 59601 (406) 441-4000 p

THESE PLANS ARE INSTRUMENTS OF PROFESSIONAL SERVICES AND ARE PROTECTED BY COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS INCLUDING COPYRIGHT. DRAWINGS MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF DAWES ENGINEERING & DESIGN COMPANY.

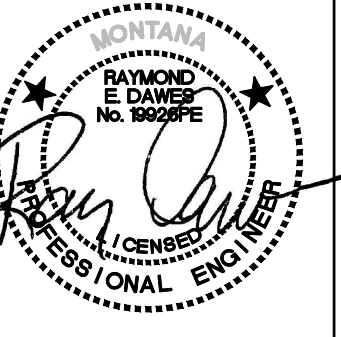

WASHOE HATCHERY ADDITION

600 W PENNSYLVANIA AVE
ANACONDA, MT 59711

SHEET CONTENTS



PLUMBING PLAN

ISSUE DATE: APRIL 29, 2016
DATE: PM
DRAWN BY: RD
CHECKED BY: RD
REV # X
REV DATE: XXXX/XXX

REV #		

SHEET NUMBER

M2.0

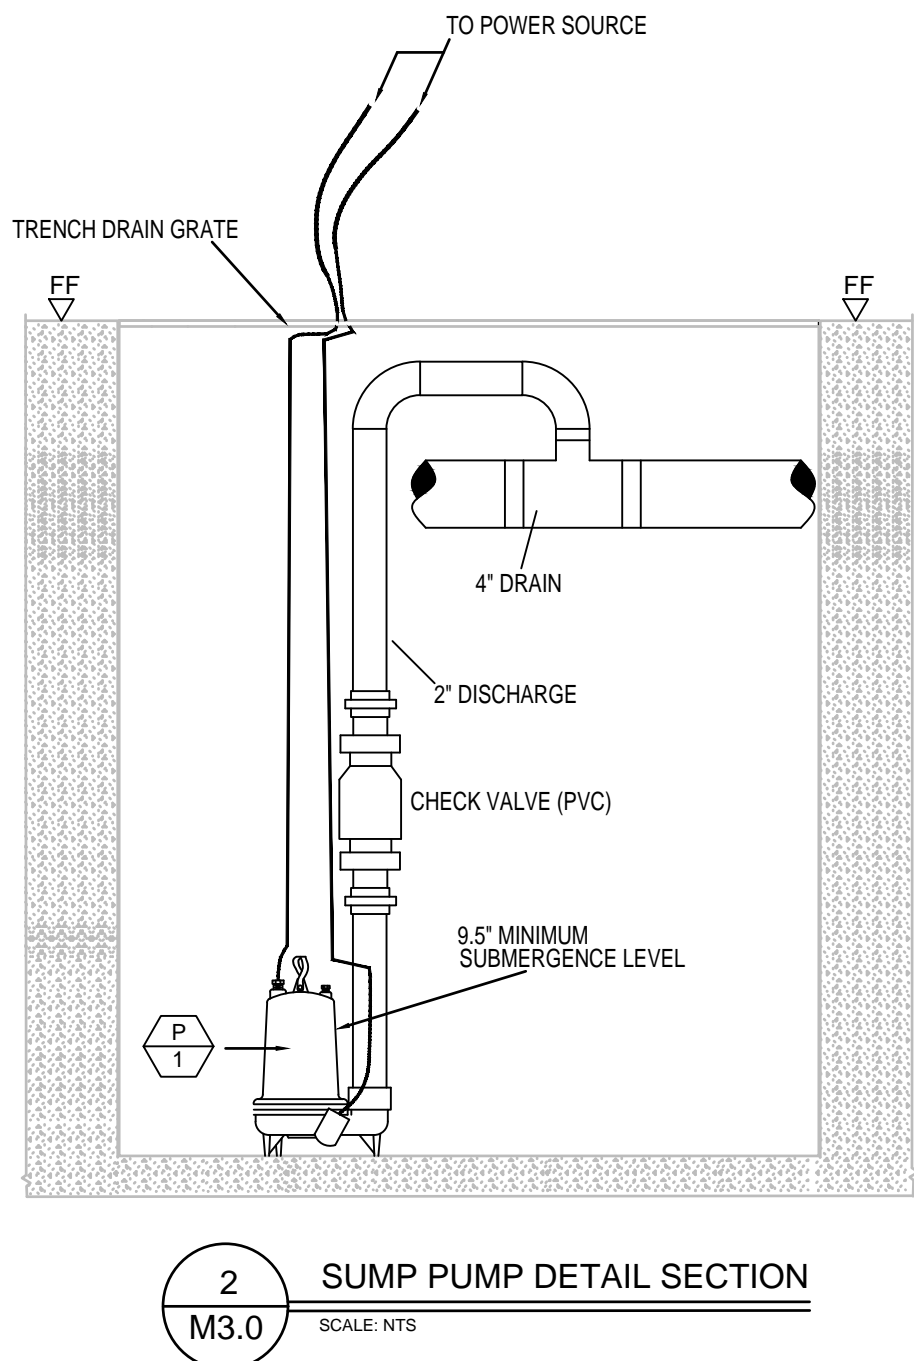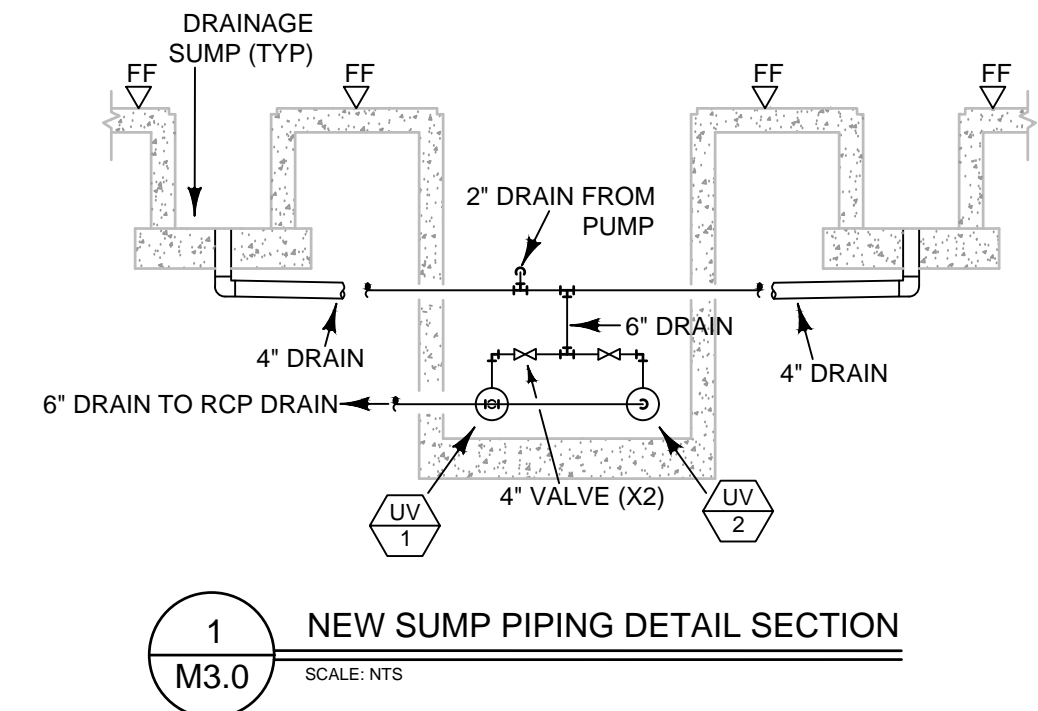

PLUMBING FIXTURE SCHEDULE								
FIXTURE TAG	DESCRIPTION	MANUFACTURER & MODEL #	PIPING CONNECTIONS					REMARKS
			TRAP	S/W	VENT	C.W.	H.W.	
FD-1	FLOOR DRAIN	ZURN ZN415BZ		4"				

GRILLE/REGISTER/DIFFUSER SCHEDULE					
SR=SUPPLY DIFFUSER		RG=RETURN GRILLE		SD=SUPPLY DIFFUSER	
EG=EXHAUST GRILLE		TG=TRANSFER GRILLE			
TAG NO.	NEXK SIZE	TYPE	MANUFACTURER AND MODEL	MATL/FINISH	OPTIONS AND ACCESSORIES
RG-1	10" X 10"	WALL MOUNT	NAILOR 7145H-O	WHITE	
Notes:					
-					

ELECTRIC HEATER SCHEDULE								
EQUIPMENT TAG	SERVICE	UNIT MODEL/SIZE	WEIGHT (LBS)	INPUT (KW) NOM	ELECTRIC		MANUFACTURER	OPTIONS-ACCESSORIES
					FLA	VOLT -PH.-CY.		
EH-1	HEATING	240-U1050D	<25	5	14.18	208/3/60	INDEECO	
EH-2	HEATING	240-U1038D	<25	3.8	10.85	208/3/60	INDEECO	
EH-3,4	HEATING	240-U1025C	<25	2.5	12.3	208/1/60	INDEECO	
NOTES:								
1. PROVIDE WITH CEILING MOUNT BRACKET, FUSED DISCONNECT, AND FACTORY WALL MOUNT THERMOSTAT.								

PUMP SCHEDULE								
ITEM TAG	SERVICE	LOCATION	MOTOR				MANUFACTURER & MODEL	OPTIONS-ACCESSORIES
			HP	RPM	VOLT.-PH.-CY.	FLA		
P-1	SUMP PUMP	MECH ROOM SUMP	1/2	3450	115-1-60	8.5	LIBERTY 287	1
NOTES:								
1. ORDER WITH 25' CORD LENGTH (-2).								

FAN SCHEDULE										
EQUIP. NUMBER	SERVICE	LOCATION	CFM	STATIC PRESS (IN WG.)	MOTOR				MANUFACTURER & MODEL	NOTES
					AMP	WATTS	SONES	VOLT/PH/CY		
EF-1	EXHAUST	HOT ROOM	50	0.25	0.53	45.1	2	120/1/60	GREENHECK SP-B70	1
EF-2	EXHAUST	REARING A	225	0.25	0.77	83.1	2.5	120/1/60	GREENHECK SP-A250	1
EF-3	EXHAUST	REARING B	154	0.25	1.3	113	2.5	120/1/60	GREENHECK SP-A190	1
RF-1	RADON	MECHANICAL ROOM	150	0.25	0.73	83	-	120/1/60	FANTECH DBF4XLT	2,3
Notes:										
1. OPERATE AS TASK EXHAUST AS CONTINUOUS (MANUAL ON/OFF) WHEN ROOM IS ENGAGED WITH FISH.										
2. OPERATE CONTINUOUSLY 24/7.										
3. SUPPLY AND INSTALL TIERLAND MODEL RA1 FAN FAILURE ALARM TO SOUND AUDIBLE ALARM WHEN FAN FAILS.										

PIPE MATERIAL AND INSTALLATION SCHEDULE							
SERVICE OR SYSTEM	MATERIAL	PIPE SIZE	INSULATION THICKNESS	PIPE SIZE	PRESSURE TEST*	NOTES:	
DOMESTIC COLD WATER	TYPE L COPPER, VIEGA PEX (INSIDE WALLS AND CRAWLSPACE ONLY), PRO-PRESS	ALL	1/2" FIBERGLASS	ALL	100 PSI AIR-30MIN	1,2	
DOMESTIC HOT WATER (100-180DEG F)	TYPE L COPPER, VIEGA PEX (INSIDE WALLS AND CRAWLSPACE ONLY), PRO-PRESS	ALL	1" FIBERGLASS	ALL	100 PSI AIR-30MIN	1,2	
SANITARY SEWER U/G	SCHEDULE 40 PVC DWW, HUBLESS CAST IRON	ALL	NONE	N/A	20 PSI AIR-60MIN		
SANITARY SEWER A/G	SCHEDULE 40 PVC DWW, HUBLESS CAST IRON	ALL	NONE	N/A	20 PSI AIR-60MIN	2	
HATCHERY PIPING	SCHEDULE 40 PVC DWW (PRESSURE) / SCHEDULE 80 SOLVENT WELD FITTINGS	ALL	NONE	N/A	25 PSI AIR-60MIN		
RADON PIPING U/G	SDR / PERFORATED	ALL	NONE	N/A	N/A		
RADON PIPING A/G	SCHEDULE 40 PVC	ALL	NONE	N/A	N/A		
NOTES:							
1) INSULATION TO BE OF HEAVY DENSITY FIBERGLASS WITH ALL SERVICE JACKET (WHITE). FITTING TO BE PVC ZESTON COVERS WITH FLEXIBLE INSULATION WRAP. SEAL ALL JOINTS WITH SEALANT. K VALUE NOT TO EXCEED 0.27 BTU PER IN/h*FT*2 DEG F.							
2) SEISMIC BRACE ALL PIPE GREATER THAN 2 1/2" ID PER LOCAL CODE.							
GENERAL NOTE: SEAL ALL NON TRATED STRUCTURE PIPE PENETRATIONS INCLUDING DRAFT SHOPS WITH SILICON OR FIRE RATED EXPANDING FOAM. SEAL ALL RATED PIPE PENETRATIONS IN ACCORDANCE WITH CONTRACTOR SELECTED MFR FIRE CAULK SYSTEM (AND OR FIRE COLLAR) AND MATCH RATING WITH SPECIFIC UL LISTING. PROVIDE ENGINEER AND INSPECTOR FOR AHJ WITH SHOP.							
* PROVIDE WRITTEN AND SIGNED REPORT BY CONTRACTOR FOR ALL SYSTEMS TESTED, TYPE OF TEST, DATE, PRESSURE, TIME START, TIME END AND SYSTEM TESTED. SUBMIT TO ENGINEER IN IOM SUBMITTAL.							

CONSTRUCTION DOCUMENT

Dawes Engineering & Design

46 Hibbard Way
Helena, MT 59601

(406) 441-4000 p

THESE PLANS ARE INSTRUMENTS OF PROFESSIONAL SERVICES AND ARE PROTECTED BY COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS INCLUDING COPYRIGHT. DRAWINGS MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF DAWES ENGINEERING & DESIGN COMPANY.

SEAL

E DAWES

No. 56292

PROFESSIONAL ENGINEER

WASHOE HATCHERY ADDITION

600 W PENNSYLVANIA AVE
ANACONDA, MT 59711

SHEET CONTENTS

EQUIPMENT SCHEDULES AND DETAILS

ISSUE DATE:
DATE: APRIL 29, 2016
DRAWN BY: PM
CHECKED BY: RD


REV # X
REV DATE: XXXX/XXX

REV #


REV #

REV #

SHEET NUMBER
M3.0

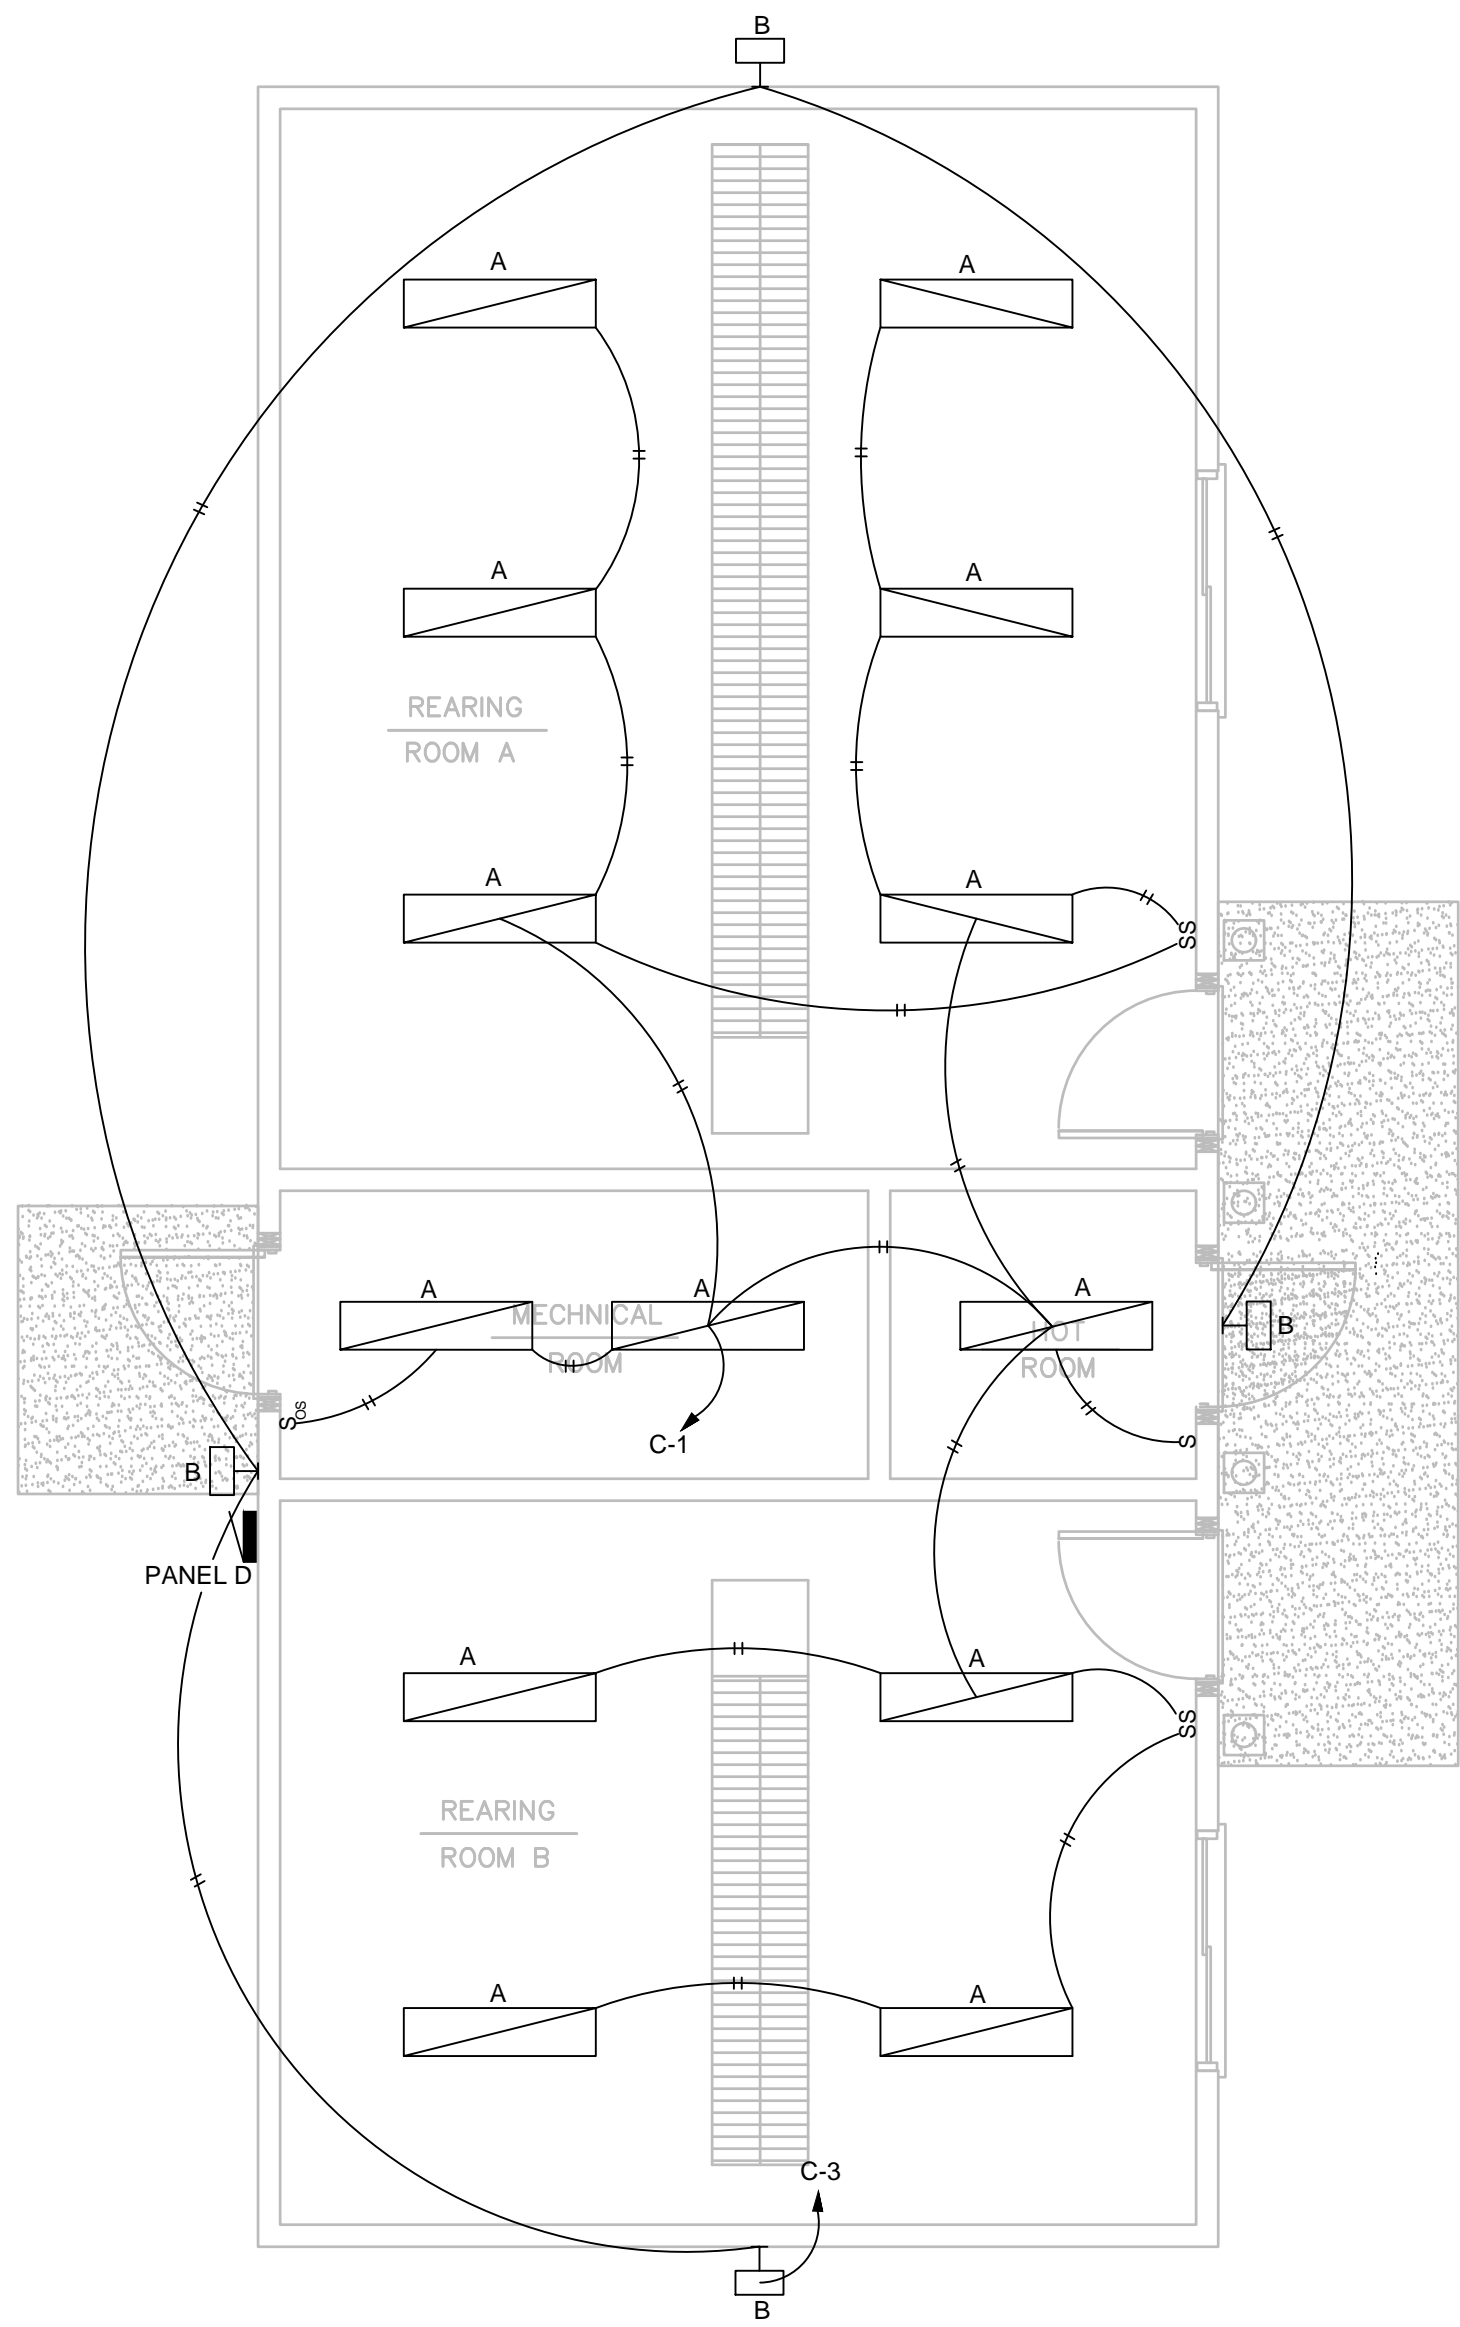


1
E1.0 NEW LIGHTING FLOOR PLAN
SCALE: 1/4"=1'

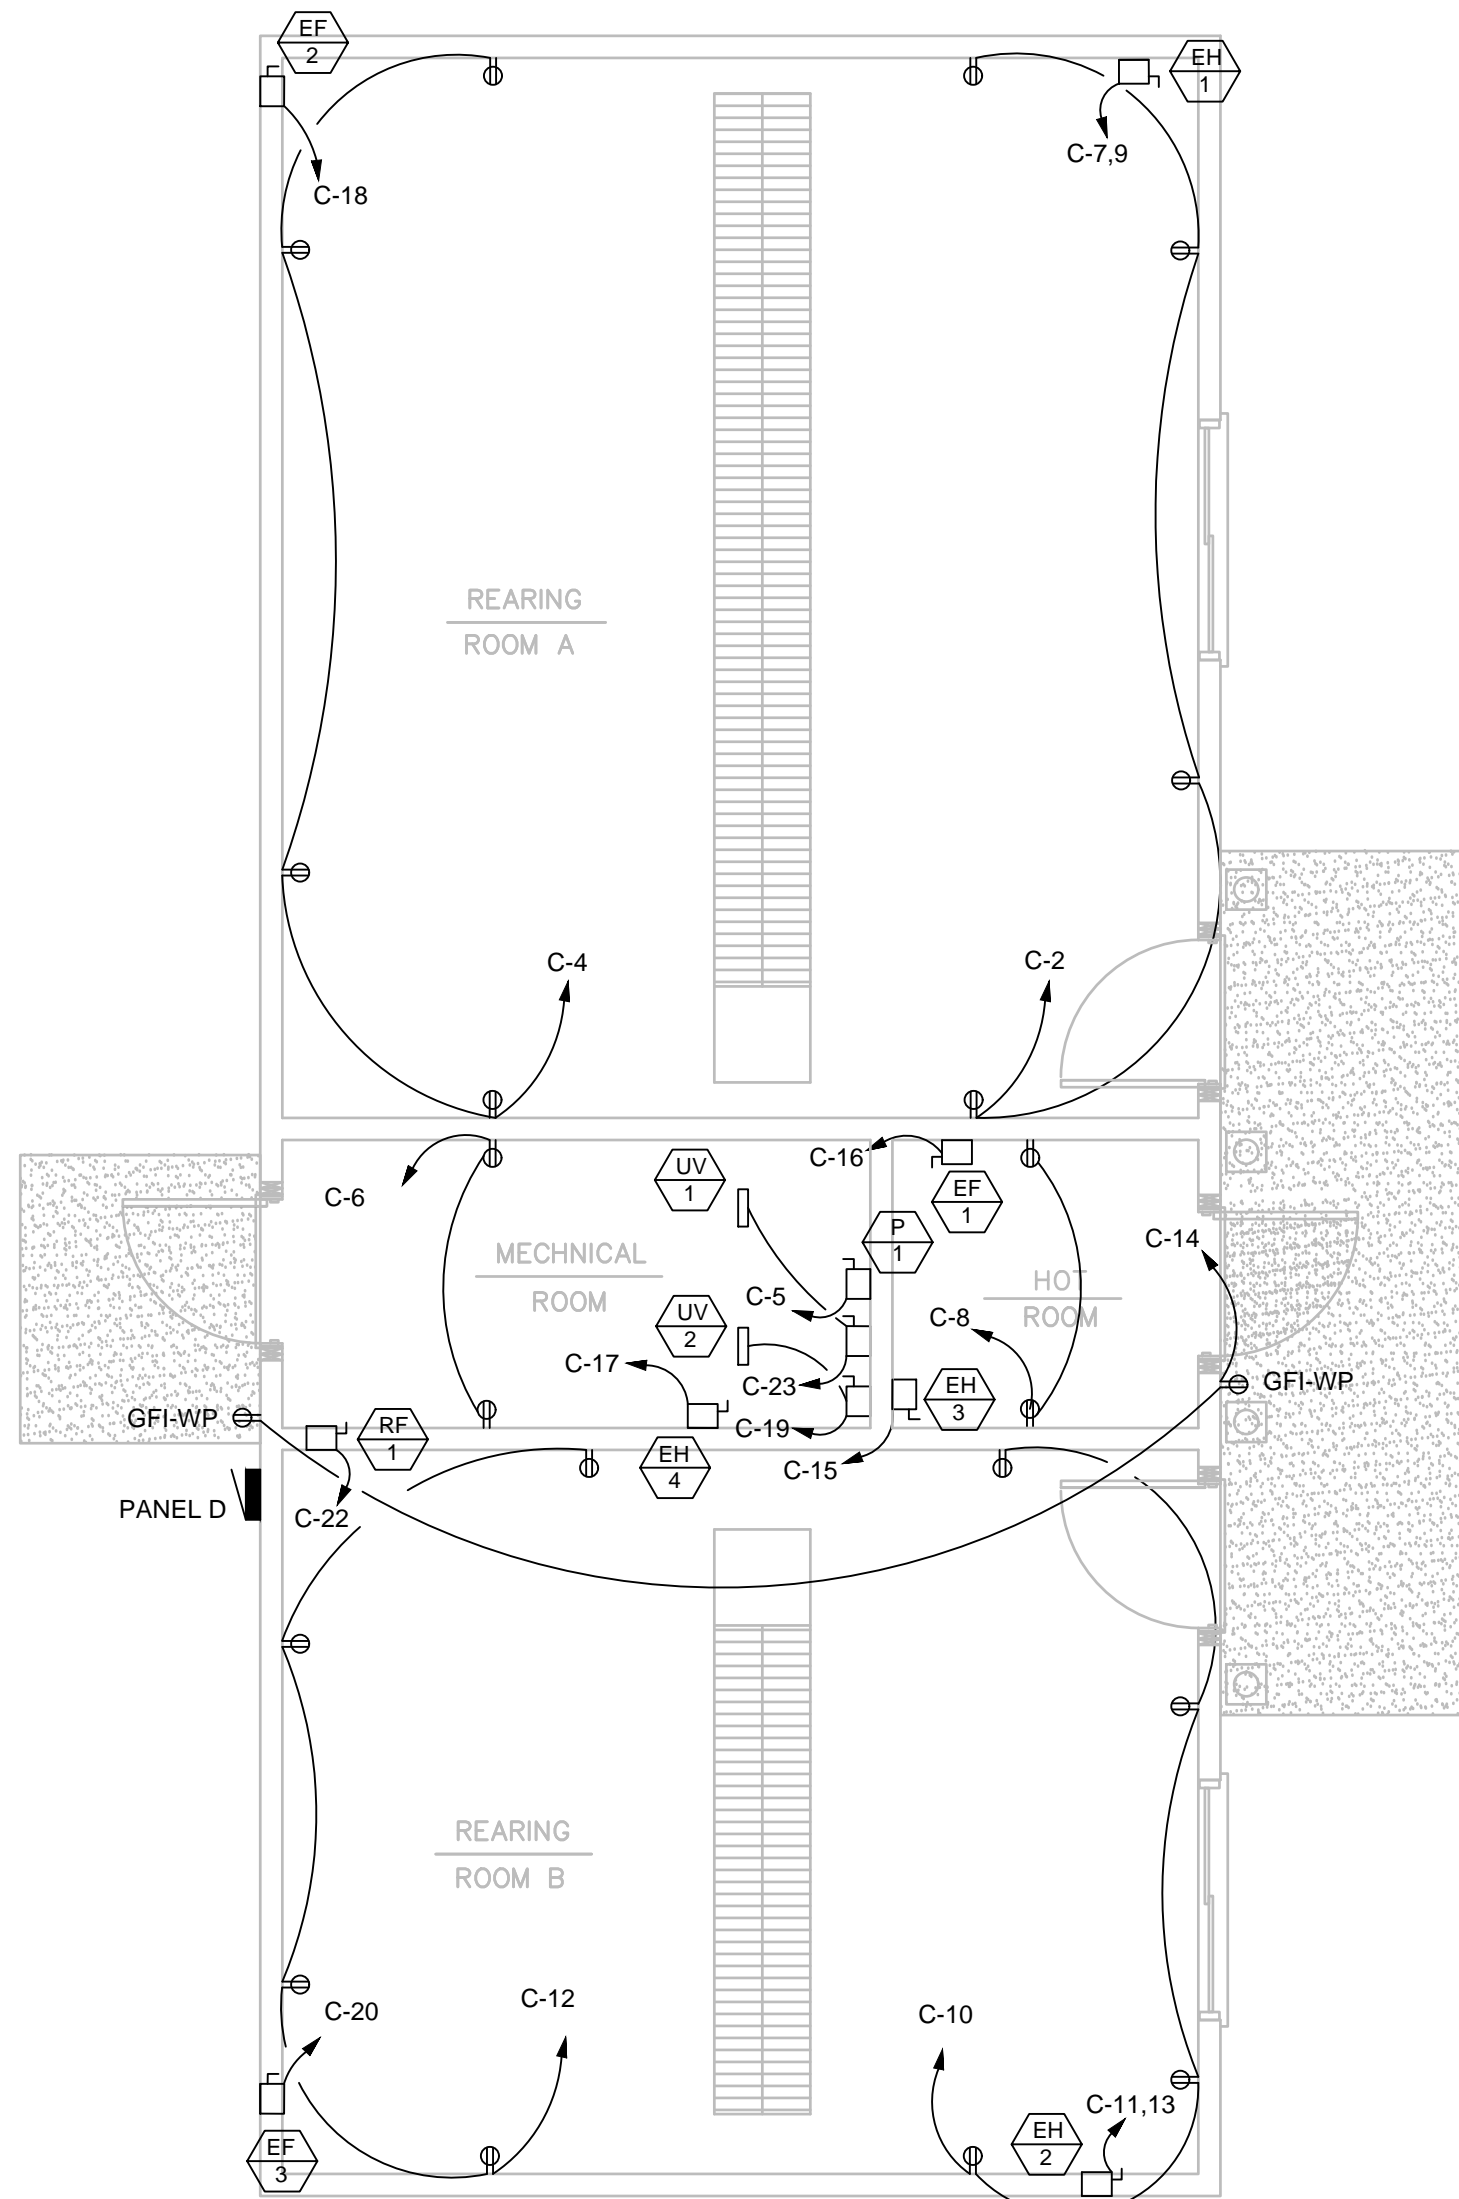

2
E1.0 NEW POWER FLOOR PLAN - ISOLATION BUILDING
SCALE: 1/4"=1'



3
E1.0 NEW POWER FLOOR PLAN - HATCHERY AND ISOLATION BUILDING
SCALE: 1/8"=1'

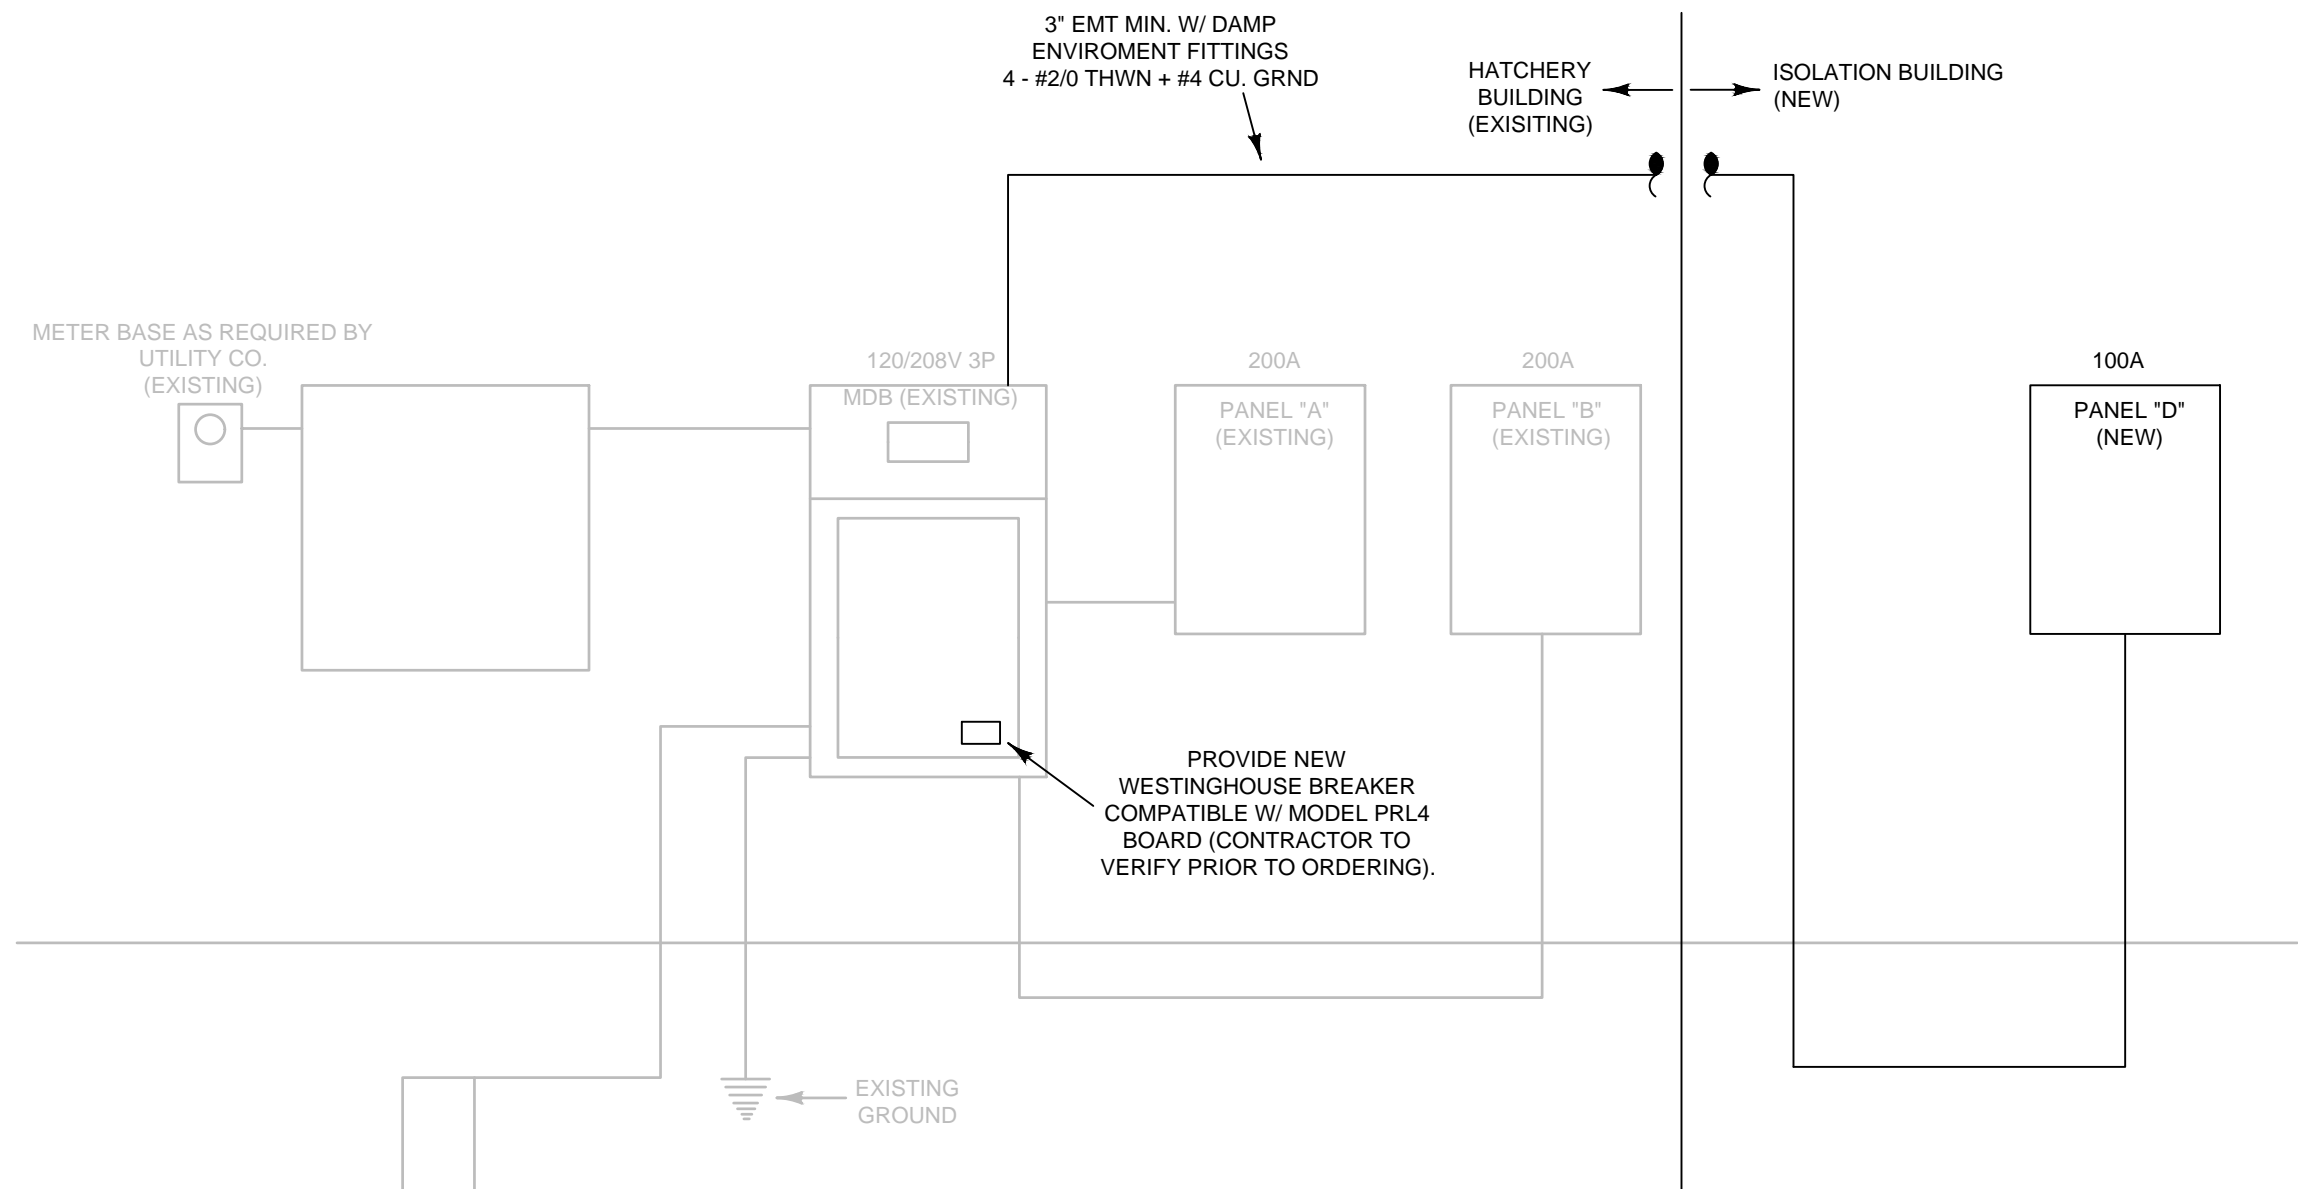

4
E1.0 SINGLE LINE POWER DISTRIBUTION ADDITION
NOT TO SCALE


GENERAL ELECTRICAL NOTES	
ALL RECEPTACLES: @48" AFF, WET APPLICATION GFCI BREAKER CIRCUIT.	
ALL RACEWAY AND WIRING METHODS TO BE INSTALLED FOR DAMP ENVIRONMENT IN NEW ISOLATION BUILDING.	
KEYED ELECTRICAL NOTES	
①	NEW RACEWAY FROM EXISTING MDB PANEL, 3" MIN.
②	NEW RACEWAY PENETRATION TO OUTSIDE. INSTALL UNDERGROUND RACEWAY TO NEW PANEL D.

CONSTRUCTION DOCUMENT

Dawes Engineering & Design

46 Hibbard Way
Helena, MT 59601 (406) 441-4000 p

THESE PLANS ARE INSTRUMENTS OF PROFESSIONAL SERVICES AND ARE PROTECTED BY COMMON LAW, STATUTORY AND OTHER RESERVED RIGHTS INCLUDING COPYRIGHT. DRAWINGS MAY NOT BE REPRODUCED OR USED FOR ANY PURPOSE WITHOUT THE WRITTEN CONSENT OF DAWES ENGINEERING & DESIGN COMPANY.

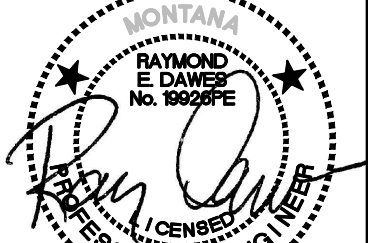

WASHOE HATCHERY ADDITION

**600 W PENNSYLVANIA AVE
ANACONDA, MT 59711**

SHEET CONTENTS:		ISSUE DATE:	
NEW LIGHTING AND POWER FLOOR PLAN		DATE:	APRIL 29, 2016
		DRAWN BY:	PM
		CHECKED BY:	RD
		REV #:	X
		REV DATE:	XX/XX/XXXX
		REV #	
		REV #	
		SHEET NUMBER	E1.0

